

Agenda Item:	IV C: Action Item
Date:	May 18, 2023
To:	Magnolia Educational & Research Foundation dba Magnolia Public Schools (“ <b>MPS</b> ”) Board of Directors (the “ <b>Board</b> ”)
From:	MPS Audit & Facilities Committee
Staff Lead(s):	Mustafa Sahin, Project Manager Patrick Ontiveros, General Counsel & Director of Facilities
RE:	Approval of Award of Contract for Asbestos and Lead Based Paint Abatement and Demolition at the Magnolia Science Academy—5 (“ <b>MSA-5</b> ”) New Construction Project at 7111 Winnetka Street.

1. **Action Proposed:**

Staff moves that the Board approve the award of a contract for (1) asbestos and lead based paint abatement and (2) site demolition for the Magnolia Science Academy—5 (“**MSA-5**”) new Construction Project at 7111 Winnetka Street to Interior Demolition (together, the “**Project**”) for a total fee of \$309,424.22 (\$229,954.22 for demolition and \$79,470.00 for asbestos abatement) and further approve that staff be authorized to negotiate and sign a professional services contract for said services in such form as staff may deem appropriate and in the best interests of Magnolia Public Schools.

2. **Purpose:**

The purpose of this proposed action is to approve the selection of Interior Demolition to abate the asbestos and lead based paint and demolish the existing building and site for the Project and to authorize MPS Staff to negotiate a final contract with Interior Demolition. The Project will be funded with the proceeds of a Charter School Facilities Program (“**CSFP**”) award from the Office of Public School Construction (“**OPSC**”).

3. **Background:**

***Acquisition of Winnetka Ave Property***

At its December 19, 2021 meeting, the MPS Board approved MPS signing a purchase and sale agreement (“**PSA**”) for the purchase of the 7111 Winnetka Ave Property and making a good faith, refundable, escrow deposit of Two Hundred Thousand Dollars (\$200,000). Escrow for the purchase and sale of the Property was opened on December 22, 2021. MPS exercised all three (3) of its options to extend the contingency period. At its June 16, 2022 meeting the Board approved the waiver of the contingencies. At the June 16th meeting the Board also approved a loan from CLI Capital to fund the acquisition of the Property.

MPS assigned to MPM Sherman Winnetka LLC (“**Winnetka LLC**”) the right to acquire and take title to the Property with a loan from CLI Capital. Winnetka Ave LLC is a subsidiary of Magnolia Properties Management, Inc., a 501(c)(3) support corporation. Concurrent with the foregoing assignment, MPS entered into a lease for the Property with Winnetka Ave LLC. Escrow on the Property closed on October 21, 2022.

### ***CSFP Award***

MPS Staff applied for funding to the OPSC’s CSFP program during the application period held from May 2, 2022 to June 3, 2022. CSFP provides funding to charter schools for new school facilities. On October 26, 2022, the State Allocation Board (“**SAB**”) approved a preliminary apportionment in the amount of \$50,832,332. Awards made by CSFP are 50% loan and 50% grant. The loan portion is paid back by the award recipient and is amortized over 30 years. The CSFP award will be used to construct a new campus for MSA-5 which is currently co-located with MSA-1 on MSA-1’s campus.

### ***Architect of Record Selection***

The DLR Group was selected as the architect of record for the Project at the Board’s January 12, 2023 meeting..

### ***Asbestos Abatement and Demolition RFP***

Staff issued an RFP for asbestos abatement and demolition on March 28, 2023, the “**RFP**”). The RFP was sent to several demolition companies and was also posted on the MPS website. A copy of the RFP is attached as Exhibit A.

### ***Construction Management RFP Responses***

Staff received a total of four (4) proposals from Interior Demolition, Venterra Environmental, Restoration Management Company and NYM Construction. The proposals are summarized below.

	Demo	Asbestos	Total	Note
<b>Interior Demolition</b>	\$229,954.22	\$79,470.00	\$309,424.22	
<b>Venterra Environmental</b>	\$274,890.00	\$149,800.00	\$424,690.00	
<b>Restoration Management Company</b>		\$235,000.00	\$235,000.00	Submitted the proposal for only asbestos abatement
<b>NYM Construction</b>	\$319,800.00		\$319,800.00	Submitted the proposal for only demolition

Interior Demolition was also selected to demo MSA-1's old gym in 2017. After careful consideration, MPS Staff determined that Interior Demolition was the best fit for the Project including but not limited to the following reasons: price and favorable experience with them in 2017 for MSA-1 demolition project. Interior Demolition's response to the RFP is attached as Exhibit B. The other three (3) responses may be found with this [link](#).

**4. Analysis & Impact:**

MSA-5 is presently co-located on MSA-1's campus. With a combined student population of approximately 1,000 students the site is highly congested. Due to space limitations, both MSA-1 and MSA-5 are constrained in accepting more students. Prior to its move to the MSA-1 campus, MSA-5 was located on prop 39 Los Angeles Unified School District campuses. The Project will allow MSA-5 to occupy its own facilities on a permanent basis. MPS is seeking to conduct demolition as soon as feasible and practical to help meet a possible August 2024 occupancy.

**5. Budget Implications:**

All costs related to the Project, including asbestos abatement and demolition fees, will be paid for with the proceeds from the CSFP award. Therefore, there should be no impact on MSA-5's budget.

**6. Committee Recommendation(s):**

MPS Audit & Facilities convened for their meeting on Wednesday, May 10<sup>th</sup> and moved to approve this item for full Board approval.

**7. Exhibits:**

Exhibit A	RFP (Page 4)
Exhibit B	Interior Demolition RFP Response (Page 73)

## *EXHIBIT A*

### *Asbestos Abatement and Demolition RFP*





# MAGNOLIA PUBLIC SCHOOLS

Request for Qualifications / Proposals  
for (1) Asbestos Containing Materials and Lead Based Paint  
Abatement and (2) Building and Site Demolition at 7111 Winnetka  
Ave, Winnetka CA 91306

Due Date:

**March 10, 2023 by 5:00 PM**

## 1.0 INTRODUCTION

Magnolia Education & Research Foundation doing-business as Magnolia Public Schools ("**MPS**"), a charter school management organization, operates Magnolia Science Academy 5 ("**MSA-5**") located at 18238 Sherman Way Reseda CA 91335. The purpose of this RFP is to obtain proposals from qualified bidders that will enable Magnolia to select a qualified firm that can assist MSA5 in (1) the asbestos abatement and (2) demolition of the existing structure and site (each a "Project" and together, the "Projects"), in preparation for construction of a new building at 7111 Winnetka Ave.

Vendors may submit a proposal for both or either of the projects.

Please see the 2.0 Project Description for details. The Projects are being funded with an award from the State of California, Office of Public School Construction, under its Charter School Facilities Program ("CSFP"). Accordingly, all the requirements of the CSFP program are applicable including, prevailing wage and all public contract code requirements.

### Site Tour

A site tour will be facilitated.

### Proposals Due

Responses to the RFP are due no later than **5:00 PM (PST), Friday, March 10, 2023**, to the following individual:

Mustafa Sahin  
Facility Project Manager  
Magnolia Public Schools  
250 East 1<sup>st</sup> Street  
Suite 1500  
Los Angeles, CA 90012  
[msahin@magnoliapublicschools.org](mailto:msahin@magnoliapublicschools.org)  
760-587-6031

Questions regarding this RFP may be directed to the individual identified above via email.

### Proposal Format:

One (1) electronic PDF copy (by email) of your proposal must be delivered to the person indicated by the deadline stated above. Please endeavor to keep any emailed material to a single manageable file size (at or about 10 MBs) so that it may be easily distributed to the Selection Committee.

Respondents are encouraged to only include information pertinent to the Projects and the Selection Committee's ability to select the vendor best suited to successfully complete this job.

### Interviews:

Interviews will be held at the discretion of MPS and MSA-5. Interviews, if any, are expected to be held according to the schedule outlined above.

### Selection Committee:

The Selection Committee will be composed of representatives from MPS and MSA-5

## 1.1 Timeline

RFP Distributed: March 1, 2023

Proposals Due:	March 10, 2023
Interviews, if any (exact date and time TBD):	Week of March 13, 2023
Selection Announced:	Week of March 13, 2023
Contract Execution:	ASAP

## 2.0 PROJECT DESCRIPTION

The general scope of work is (1) the abatement of the asbestos and lead based paint and (2) the demolition of the existing one story structure and site asphalt on the site as indicated on the attached Alta survey and detailed within the scope of work. The site address is 7111 Winnetka Ave, Winnetka CA 91306. The successful respondent(s) shall be responsible for the following:

- Obtain all permits as required by State, County and Local Authorities.
- All soil erosion and sedimentation control measures as required including maintenance of such.
- All utility shutdowns and disconnections, including scheduling and coordination with utility companies, including demolition and capping of utilities at right of way for future use. This includes but is not restricted to electric, natural gas, water, storm, sanitary, phone, cable and fiber optic. All utility company fees for disconnections will be paid by the Owner.
- Lead and Asbestos Abatement per the LBP & ABM report.
- All Investigations and Assessments needed to develop a suitable abatement and demolition plan.
- Complete demolition of the structure on the property, including but not restricted to all below grade footings, foundations, slabs, piping, wiring and ductwork.
- Backfill of all excavated and/or demolished areas with compacted fill material.
- Coordination with all Owner's Consultants and Contractors.
- The selected firm shall provide temporary facilities, services, barriers, pollution controls, prevention of wind-blown debris leaving the site, enclosures, and removal and legal disposal of all demolition and construction debris as required by local, state, and federal codes. This includes securing the site during demolition, and until construction activity begins, with a temporary fence around the demolition areas.
- All demolition work must adhere to all municipal demolition regulations. It is the responsibility of the demolition contractor to verify these regulations and to adhere to them at all times.
- The existing one-story wood frame building is approximately 21,000 square feet and was constructed in 1979.
- The demolition plan will need to be submitted and approved by the City of Los Angeles Department of Building and Safety. Securing a demolition permit, and all other necessary municipal approvals, will be the responsibility of the selected firm.
- All bidders shall be responsible for familiarizing themselves with on-site job conditions. Failure to do so shall in no way incur any delays in work or extra cost to the Owner.

The building and premises are available for examination. Please coordinate site access with Mustafa Sahin, msahin@magnoliapublicschools.org or (760) 587-6031.

## 3.0 PROPOSAL FORMAT

Respondent shall format its response as set forth below to facilitate timely review and selection. Please be specific to the RFP, and do not include materials not explicitly requested, such as generic marketing materials.

### **Your response should include the following:**

- Letter of interest
- Name of your company and the individual responsible for the account
- Restate all the requirements of Section 4.0 and provide responses to each.

See Section 1.0 for additional proposal format clarifications.

## **4.0 PROPOSAL REQUIREMENTS**

### **4.1 Vendor Qualifications and Experience**

#### **4.1.1 Vendor Description.**

Provide a description of your company and why it is qualified to undertake the Project(s). In particular, describe your experience with similar projects (that is, projects subject to the California Public Contract code).

Provide the following:

A minimum of three (3) references, including

- (a) name and scope of the project
- (b) client name and contact information
- (c) contract amount

#### **4.1.2 Qualifications and Experience of Key Personnel.**

Identify the person(s) that will be principally responsible for working with the MPS and leading this engagement and their qualifications and experience.

#### **4.1.3 Insurance.**

Provide a description of vendor's insurance coverage.

### **4.2 Cost**

Respondent's proposal should include an overall cost and should be broken down in detail. The proposal should also provide a break-down of any and all other costs and fees including, but not limited to, labor, delivery fees, installation fees, applicable taxes, etc.

### **4.3 Schedule**

MPS and MSA-SA desire to complete this project as soon as possible, please also provide the expected completion of the project.

### **4.4 Contract**

The successful respondent will be required to sign an agreement with Owner in the form of (AIA Document A101-2017). Please provide an affirmative statement of respondent's concurrence or else any changes that respondent desires to make to the form.

## **5.0 CONTACT**

Questions to Owner will be accepted via email by the Project Manager identified above. Answers to questions will be provided to all participants as available.

## **6.0 RFP/Q EXHIBITS**

**Exhibit A- Alta Survey**  
**Exhibit B- Asbestos Test**

## **7.0 BID ACCEPTANCE/REJECTION & MODIFICATION**

The Owner reserves the right to modify this RFP/Q, reject any or all proposals, cancel the solicitation process at its sole discretion. Owner will endeavor to inform all parties who have expressed interest in submitting a response to this RFP/Q of any such changes.

## **8.0 PROPOSAL VALIDITY**

RFP responses shall be valid until execution of a contract, which is expected to occur on or about the week of March 13, 2023. No changes to information received within the Respondent's proposal shall be changed or altered without approval by the Owner.

# Exhibit A

## ALTA and Topo Survey



LEGAL DESCRIPTION:

THE LAND REFERRED TO HEREIN BELOW IS SITUATED IN THE CITY OF LOS ANGELES, COUNTY OF LOS ANGELES, STATE OF CALIFORNIA, AND IS DESCRIBED AS FOLLOWS:

LOTS 1 AND 2 OF TRACT NO. 24753, IN THE CITY OF LOS ANGELES, COUNTY OF LOS ANGELES, STATE OF CALIFORNIA, AS PER MAP RECORDED IN BOOK 642 PAGES 47 AND 48 OF MAPS, IN THE OFFICE OF THE COUNTY RECORDER OF SAID COUNTY.

EXCEPTING THEREFROM LOT 2 AND THE NORTHERLY 30.05 FEET OF LOT 1, ALL MINERALS, OILS, PETROLEUM, AND KINDRED SUBSTANCE AND NATURAL GAS UNDER AND IN SAID LAND AS RESERVED IN DEED FROM W. F. RUTSHAUSER AND WIFE RECORDED IN BOOK 16963 PAGE 322, OFFICIAL RECORDS.

APN: 2135-038-016

PRELIMINARY REPORT PREPARED BY:

FIDELITY NATIONAL TITLE COMPANY

4400 MacArthur Blvd., Suite 200, Newport Beach, CA 92660  
TITLE OFFICER: Thomas Szopinski - TEL: (949) 622-5000

EXCEPTION ITEMS PER ORDER NO. 002-30078511-TS4, DATED DECEMBER 6, 2021

NOTE: EXCEPTION ITEMS IN THE PRELIMINARY REPORT IS PREPARED FOR THE CONVENIENCE OF THOSE PERSONS USING THIS SURVEY.  
FOR FULL DETAILS OF TITLE ITEMS, REFER TO THE COMPLETE REPORT AND TO THOSE DOCUMENTS REFERRED TO THEREIN.

- ITEM NO. A. PROPERTY TAXES, INCLUDING ANY PERSONAL PROPERTY TAXES AND ANY ASSESSMENTS COLLECTED TAXES, ARE AS FOLLOWS:
- TAX IDENTIFICATION NO.: 2135-038-016  
FISCAL YEAR: 2021-2022  
1ST INSTALLMENT: \$34,871.37, PAID.  
2ND INSTALLMENT: \$34,871.37, OPEN (DELINQUENT AFTER APRIL 10)  
PENALTY AND COST: \$3,497.13  
HOMEOWNERS EXEMPTION: \$0.00  
CODE AREA: 00016
- B. THE LIEN OF SUPPLEMENTAL OR ESCAPED ASSESSMENTS OF PROPERTY TAXES, IF ANY, MADE PURSUANT TO THE PROVISIONS OF CHAPTER 3.5 (COMMENCING WITH SECTION 75) OR PART 2, CHAPTER 3, ARTICLES 3 AND 4, RESPECTIVELY, OF THE REVENUE AND TAXATION CODE OF THE STATE OF CALIFORNIA AS A RESULT OF THE TRANSFER OF TITLE TO THE VESTEE NAMED IN SCHEDULE A OR AS RESULT OF CHANGES IN OWNERSHIP OR NEW CONSTRUCTION OCCURRING PRIOR TO DATE OF POLICY.
1. WATER RIGHTS, CLAIMS OR TITLE TO WATER, WHETHER OR NOT DISCLOSED BY THE PUBLIC RECORDS.
2. EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO AS SET FORTH IN A DOCUMENT:
- PURPOSE: POLE LINES AND CONDUITS  
RECORDING NO.: IN BOOK 6044, PAGE 99, DEEDS  
THE EXACT LOCATION AND EXTENT OF SAID EASEMENT IS NOT DISCLOSED OF RECORD.  
(SURVEYOR'S NOTE: FALLS WITHIN STREET RIGHT OF WAY)
3. AN EASEMENT FOR STREET PURPOSES OVER THAT PORTION OF SAID LAND SHOWN AS "FUTURE STREET" ON THE MAP OF SAID TRACT NO. 24753, AND ACCEPTED BY RESOLUTION ADOPTED BY THE COUNCIL OF THE CITY OF LOS ANGELES, A COPY THEREOF BEING RECORDED FEBRUARY 8, 1963 AS INSTRUMENT NO. 5877, OFFICIAL RECORDS.
4. A COVENANT AND AGREEMENT REGARDING MAINTENANCE OF YARDS OF AN OVERSIZED BUILDING
- EXECUTED BY: CALIFORNIA MEDICAL GROUP HEALTH PLAN, INC.  
IN FAVOR OF: CITY OF LOS ANGELES  
RECORDING DATE: JUNE 14, 1979  
RECORDING NO.: AS INSTRUMENT NO. 79-646882, OFFICIAL RECORDS  
REFERENCE IS HEREBY MADE TO SAID DOCUMENT FOR FULL PARTICULARS.  
THIS COVENANT AND AGREEMENT PROVIDES THAT IT SHALL BE BINDING UPON ANY FUTURE OWNERS, ENCUMBRANCERS, THEIR SUCCESSORS OR ASSIGNS, AND SHALL CONTINUE IN EFFECT UNTIL THE ADVISORY AGENCY APPROVES TERMINATION.
5. THE LAND DESCRIBED HEREIN IS INCLUDED WITHIN A PROJECT AREA OF THE REDEVELOPMENT AGENCY SHOWN BELOW, AND THAT PROCEEDING FOR THE REDEVELOPMENT OF SAID PROJECT HAVE BEEN INSTITUTED UNDER THE REDEVELOPMENT LAW (SUCH REDEVELOPMENT TO PROCEED ONLY AFTER THE ADOPTION OF THE REDEVELOPMENT PLAN) AS DISCLOSED BY A DOCUMENT.
- REDEVELOPMENT AGENCY: COMMUNITY REDEVELOPMENT AGENCY OF THE CITY OF LOS ANGELES  
RECORDING DATE: NOVEMBER 30, 2007  
RECORDING NO.: AS INSTRUMENT NO. 20072636424, OFFICIAL RECORDS
6. A DEED OF TRUST TO SECURE AN INDEBTEDNESS IN THE AMOUNT SHOWN BELOW,
- AMOUNT: \$1,200,00.00  
DATE: OCTOBER 11, 2017  
TRUSTOR/ GRANTOR: RAINBOW INVESTMENTS LLC, A CALIFORNIA LIMITED LIABILITY COMPANY, AS TO AN UNDIVIDED 50% INTEREST AND WINNETKA LIFE PARTNERS, LLC AS TO AN UNDIVIDED 50% INTEREST AS TENANTS IN COMMON  
TRUSTEE: GRANDPOINT BANK  
BENEFICIARY: GRANDPOINT BANK  
LOAN NO.: 154418355  
RECORDING DATE: OCTOBER 30, 2017  
RECORDING NO.: AS INSTRUMENT NO. 20171242820, OFFICIAL RECORDS
7. AN ASSIGNMENT OF ALL THE MONEYS DUE, OR TO BECOME DUE AS RENTAL, AS ADDITIONAL SECURITY FOR THE OBLIGATIONS SECURED BY DEED OF TRUST SHOWN AS ITEM NO. 6
- ASSIGNED TO: GRANDPOINT BANK  
RECORDING DATE: OCTOBER 30, 2017  
RECORDING NO.: AS INSTRUMENT NO. 20171242821, OFFICIAL RECORDS
8. MATTERS CONTAINED IN THAT CERTAIN DOCUMENT
- ENTITLED: HAZARDOUS SUBSTANCES CERTIFICATE AND INDEMNITY AGREEMENT  
DATED: OCTOBER 11, 2017  
EXECUTED BY: WINNETKA LIFE PARTNERS, LLC, RAINBOW INVESTMENTS, LLC AND GRANDPOINT BANK  
RECORDING DATE: OCTOBER 30, 2017  
RECORDING NO.: AS INSTRUMENT NO. 20171242822, OFFICIAL RECORDS  
REFERENCE IS HEREBY MADE TO SAID DOCUMENT FOR FULL PARTICULARS.
9. A FINANCING STATEMENT AS FOLLOWS:
- DEBTOR: WINNETKA LIFE PARTNERS, LLC AND RAINBOW INVESTMENTS, LLC  
SECURED PARTY: GRANDPOINT BANK  
RECORDING DATE: OCTOBER 30, 2017  
RECORDING NO.: AS INSTRUMENT NO. 20171242823, OFFICIAL RECORDS
10. ANY EASEMENTS NOT DISCLOSED BY THE PUBLIC RECORDS AS TO MATTERS AFFECTING TITLE TO REAL PROPERTY, WHETHER OR NOT SAID EASEMENT ARE VISIBLE AND APPARENT.
11. MATTERS WHICH MAY BE DISCLOSED BY AN INSPECTOR AND/OR BY A CORRECT ALTA/NSPS LAND TITLE SURVEY OF SAID LAND THAT IS SATISFACTORY TO THE COMPANY, AND/OR BY INQUIRY OF THE PARTIES IN POSSESSION THEREOF.
12. ANY RIGHTS OF THE PARTIES IN POSSESSION OF A PORTION OF, OR ALL OF, SAID LAND, WHICH RIGHTS ARE NOT DISCLOSED BY THE PUBLIC RECORDS.
- THE COMPANY WILL REQUIRE, FOR REVIEW, A FULL AND COMPLETE COPY OF ANY UNRECORDED AGREEMENT, CONTRACT, LICENSE AND/OR LEASE, TOGETHER WITH ALL SUPPLEMENTS, ASSIGNMENTS AND AMENDMENTS THERETO, BEFORE ISSUING ANY POLICY OF TITLE INSURANCE WITHOUT EXCEPTING THIS ITEM FROM COVERAGE.
- THE COMPANY RESERVES THE RIGHT TO EXCEPT ADDITIONAL ITEMS AND/OR MAKE ADDITIONAL REQUIREMENTS AFTER REVIEWING SAID DOCUMENTS.


CERTIFICATION:

TO: FIDELITY NATIONAL TITLE COMPANY, RAINBOW INVESTMENTS, LLC, A CALIFORNIA LIMITED LIABILITY COMPANY, AS TO AN UNDIVIDED 50% INTEREST AND WINNETKA LIFE PARTNERS, LLC, AS TO AN UNDIVIDED 50% INTEREST AS TENANTS IN COMMON AND MAGNOLIA EDUCATIONAL & RESEARCH FOUNDATION

THIS IS TO CERTIFY THAT THIS MAP OR PLAT AND THE SURVEY ON WHICH IT IS BASED WERE MADE IN ACCORDANCE WITH THE 2021 MINIMUM STANDARD DETAIL REQUIREMENTS FOR ALTA/NSPS LAND TITLE SURVEYS, JOINTLY ESTABLISHED AND ADOPTED BY ALTA AND NSPS, AND INCLUDES ITEMS 2, 3, 4, 5, 6a, 6b, 7a, 7b1, 7c, 8, 9, 10, 11a, 11b, 13, 14, 16 & 18 OF TABLE A THEREOF. THE FIELDWORK WAS COMPLETED ON FEBRUARY 06, 2022

DATE OF COMPLETED MAP: FEBRUARY 22, 2022

GERARDO GARCIA MONTES, PLS 9195

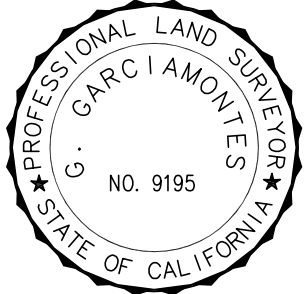

SURVEYOR'S NOTE:

GMON SURVEYING, INC., HAS RELIED SOLELY ON THE MENTIONED REPORT ORDER NO. 002-30078511-TS4, DATED DECEMBER 06, 2021, PREPARED BY FIDELITY NATIONAL TITLE COMPANY TO LOCATE TITLE MATTERS SHOWN HEREON UNLESS NOTED OTHERWISE. GMON SURVEYING, INC MAKES NO STATEMENT AS TO THE ACCURACY OR COMPLETENESS OF THE HEREON REFERENCED TITLE REPORT.

FURTHER ALL INTERESTED PARTIES ARE ADVISED THAT LIENS, TAXES, C.C. & R'S, TRUST DEEDS, COUNTY CONDITIONS, ORDINANCES, REGULATIONS, STANDARDS OR POLICIES HAVE NOT BEEN ADDRESSED BY THIS SURVEY OTHER THAN AS NOTED HEREON, AND THEN ONLY TO THE EXTENT ADDRESSED HEREON.

ITEMS 6A, 6B, 11A & 11B: DOCUMENTS NOT PROVIDED

NO EVIDENCE OF RECENT EARTH MOVING WORK, BUILDING CONSTRUCTION, OR BUILDING ADDITIONS OBSERVED ON THE PROCESS OF CONDUCTING THE FIELDWORK

BASIS OF BEARINGS:

THE BEARING N 00°01'17" W OF THE CENTERLINE OF WINNETKA AVENUE, AS SHOWN ON TRACT NO. 24753, RECORDED IN BOOK 642, PAGES 47 & 48, WAS USED AS THE BASIS OF BEARINGS SHOWN ON THIS MAP.

ABBREVIATIONS:


C.E.F.B. CITY ENGINEER FIELD BOOK  
C/L CENTERLINE  
M.B. MAP BOOK  
PG. PAGE  
PGS. PAGES

FLOOD ZONE:


AREA FALLS IN ZONE X - AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN PER FEMA FIRM COMMUNITY PANEL NO. 06037C1280F, DATED SEPTEMBER 26, 2008

GROSS SITE AREA:


75,702 SQ.FT.

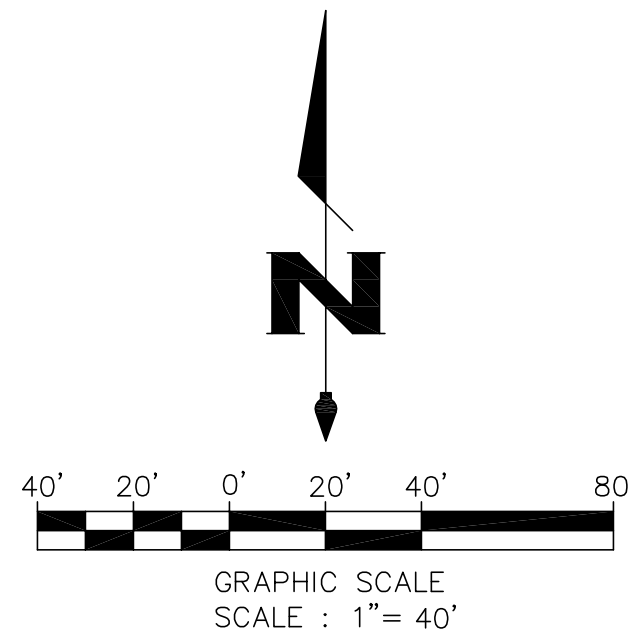

VICINITY MAP  
NO SCALE

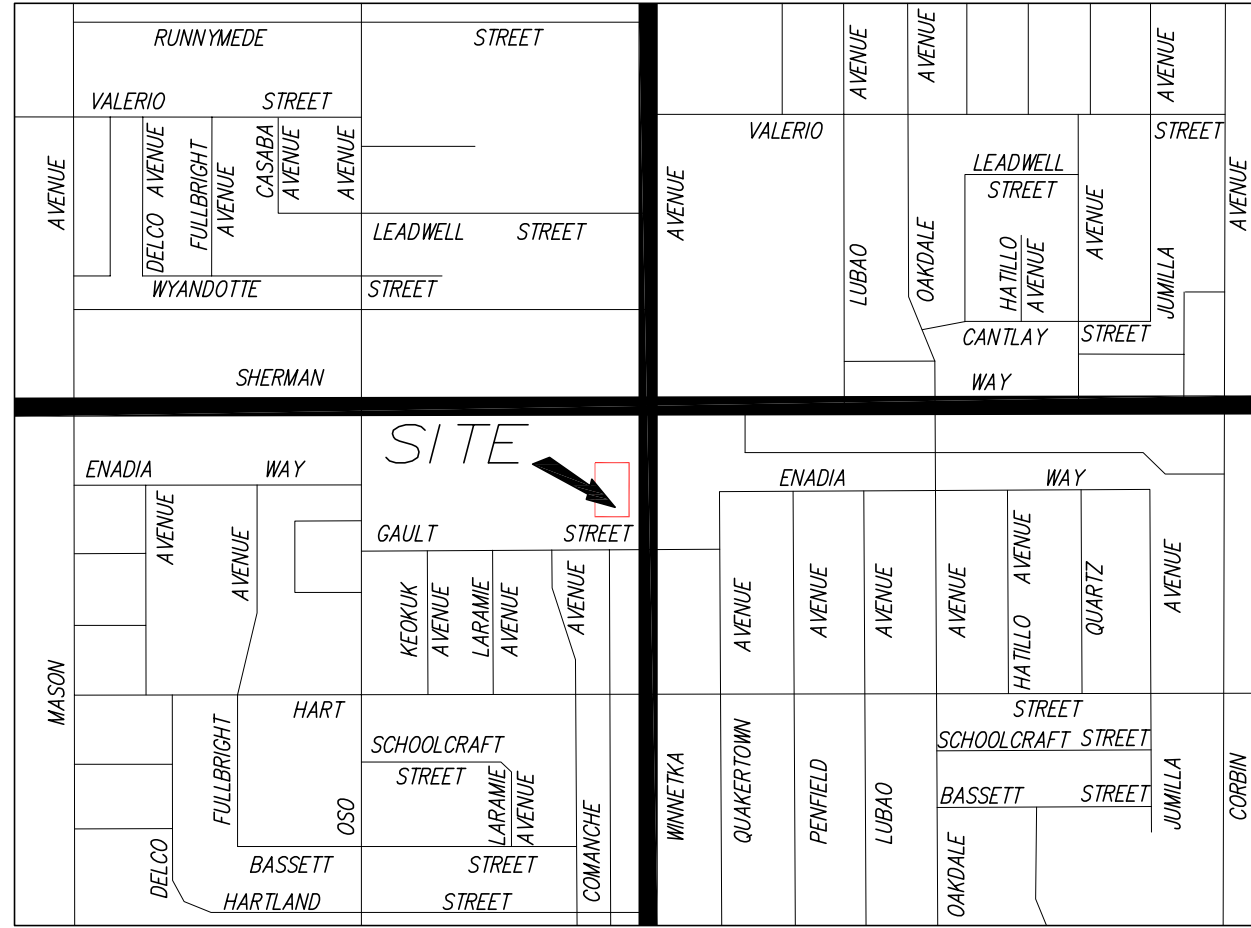

BOUNDARY ESTABLISHMENT

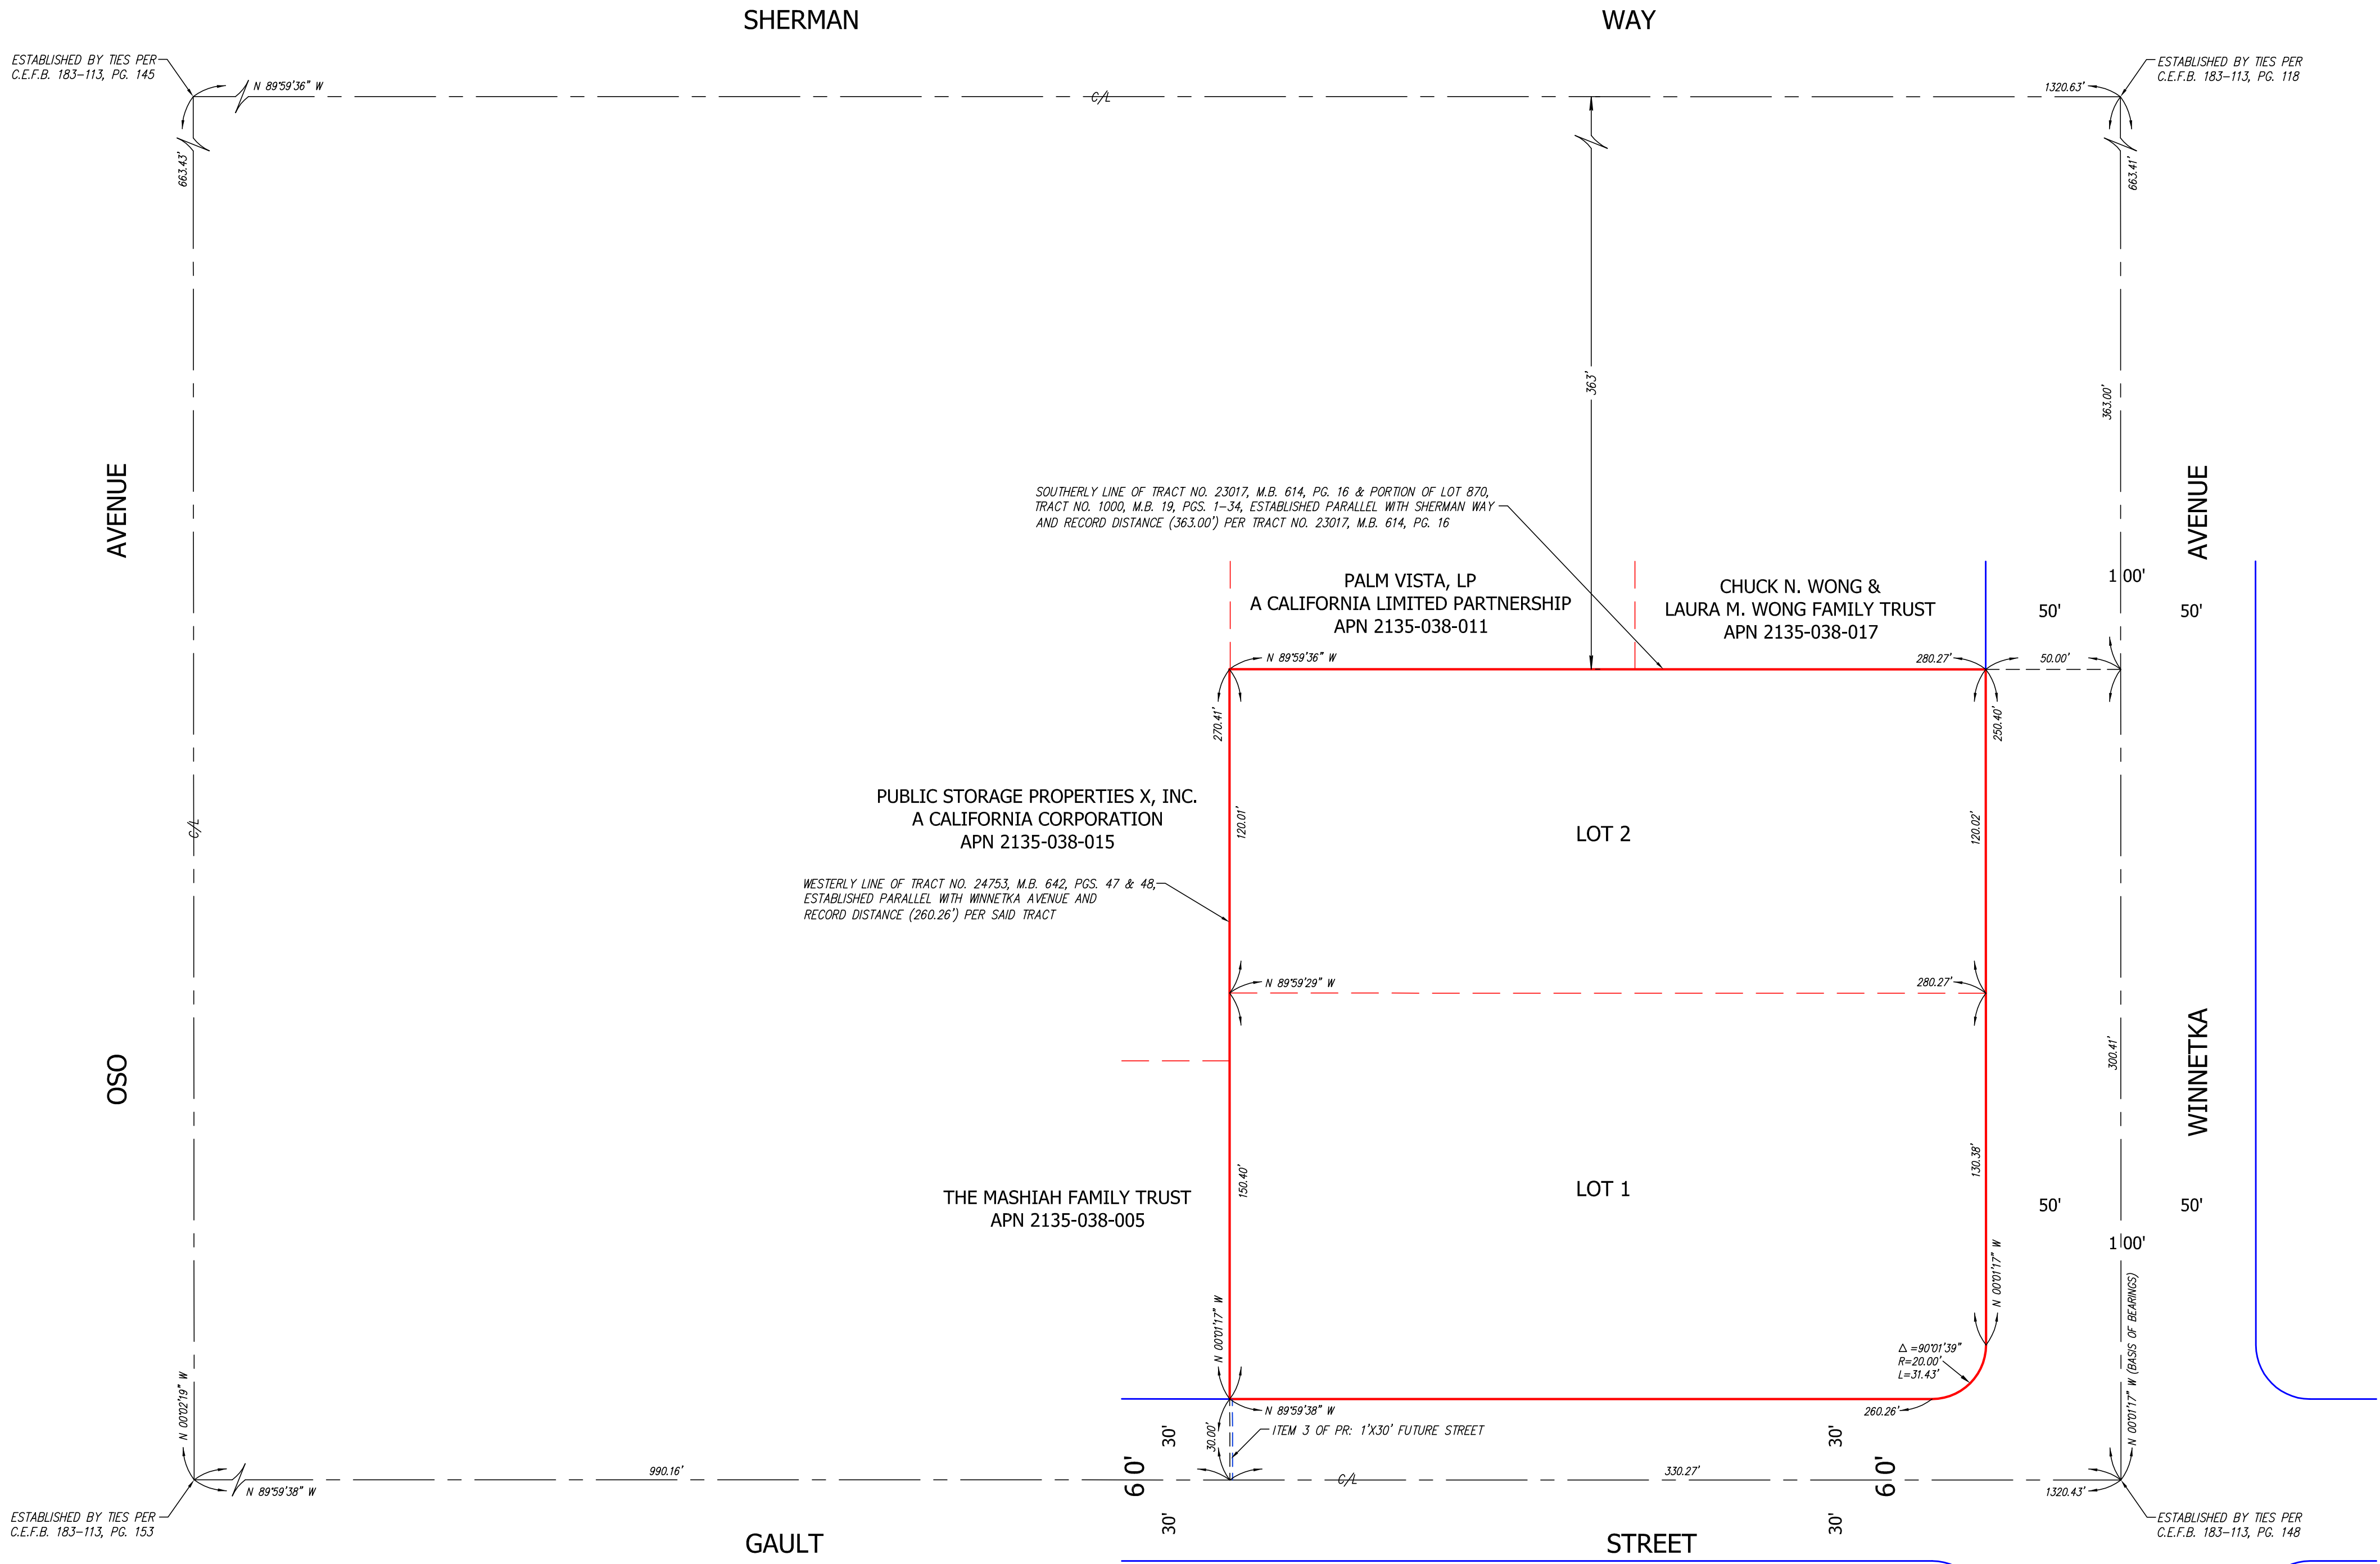

PREPARED BY:  
**GMON Surveying, Inc.**  
Gerardo Garcia Montes, PLS 9195

200 N. San Fernando Road #318, Los Angeles CA 90031  
Office: 323.336.6725 | 818.478.2017  
gmonsurveying.com

PREPARED FOR:  
**Magnolia Educational & Research Foundation**  
(323) 490-0701

**ALTA/NSPS LAND TITLE SURVEY**  
Lots 1 & 2, Tract No. 24753,  
M.B. 642, Pgs. 47 & 48  
7111 Winnetka Avenue  
Winnetka, CA 91306

REVISION NOTES	
DATE	DESCRIPTION

JOB NO. 22-1917

SCALE: 1" = 40'

DATE: FEB 2022


DRAFTED: CF

SHEET NO.

1

OF 2 SHEETS



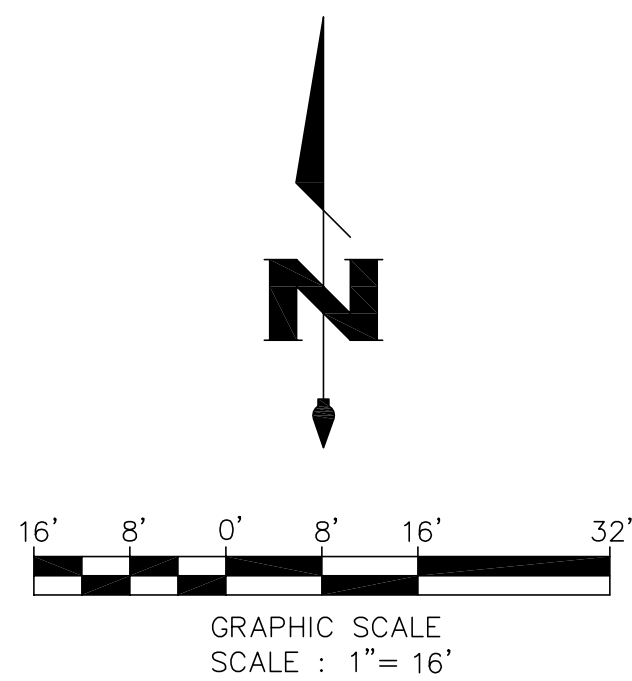

PUBLIC STORAGE PROPERTIES X, INC.  
A CALIFORNIA CORPORATION  
APN 2135-038-015

THE MASHIAH FAMILY TRUST  
APN 2135-038-005

PALM VISTA, LP  
A CALIFORNIA LIMITED PARTNERSHIP  
APN 2135-038-011

CHUCK N. WONG & LAURA M. WONG FAMILY TRUST  
APN 2135-038-017

COMMERCIAL BUILDING  
21,499 SQ. FT.  
7111 WINNETKA AVE  
WINNETKA, CA 91306

LOT 2

LOT 1

AVENUE

WINNETKA

GAULT

STREET

#### ABBREVIATIONS:

BLDD BOLLARD  
BS BOTTOM OF STEP  
C/L CENTERLINE  
EG EDGE OF GUTTER  
FF FINISHED FLOOR  
FL FLOWLINE  
FS FINISHED SURFACE  
GM GAS METER  
L/L LOT LINE  
LGT LIGHT POST  
PLM PALM TREE  
PS PARKING SIGN  
R/W RIGHT OF WAY  
SDMH STORM DRAIN MANHOLE  
SL STREET LIGHT  
SLPX STREET LIGHT PULL-BOX  
SMH SEWER MANHOLE  
SS STREET SIGN  
TC TOP OF CURB  
TG TOP OF GRATE  
TH THRESHOLD  
TR TREE  
TRCL TREE CLUSTER  
TRNF TRANSFORMER  
TS TOP OF STEP  
TW TOP OF WALL  
TYP TYPICAL  
ULD UTILITY LID  
UP UTILITY POLE  
WM WATER METER  
WWL WING WALL

#### BENCH MARK:

B.M. NO. 07-07245 NAVD 1988 LOS ANGELES CITY BENCH MARK

WIRE SPK IN W CURB WINNETKA AVE; 2FT S OF BC CURB RET S OF GAULT ST

ELEVATION = 765.873 FEET

(ADJUSTMENT 2000)



PREPARED BY:

**GMON Surveying, Inc.**

Gerardo Garcia-Montes, PLS 9195

200 N. San Fernando Road #318, Los Angeles CA 90031  
Office: 323.336.6725 | 818.478.2017  
gmonsurveying.com

PREPARED FOR:

**Magnolia Educational &  
Research Foundation**

(323) 490-0701

#### ALTA/NSPS LAND TITLE SURVEY

Lots 1 & 2, Tract No. 24753,  
M.B. 642, Pgs. 47 & 48

SITE AREA:  
75,702 SQ. FT.

#### REVISION NOTES

DATE	DESCRIPTION	BY

JOB NO. 22-1917

SCALE: 1" = 16'

DATE: FEB 2022

DRAFTED: CF

SHEET NO.

**2**

OF 2 SHEETS



## Exhibit B

### ACM and LBP Report



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL



Project Number: 1031500

Re: Limited Asbestos Containing Materials and  
Lead-Based Paint Survey Report  
Winnetka Offices  
7111 Winnetka Avenue  
Canoga Park, CA 91306

CSC Local Office: Clark Seif Clark, Inc.  
PO Box 4299  
Chatsworth, CA 91313  
Office: 818-727-2553  
Fax: 818-727-2556

Client: Magnolia Public Schools  
Mr. Mustafa Sahin M.Ed.  
250 E. 1st Street, Suite 1500  
Los Angeles, CA 90012

Date Report Issued: November 7, 2022

## TABLE OF CONTENTS

<b>I.</b>	<b>INTRODUCTION.....</b>	<b>3</b>
<b>II.</b>	<b>PURPOSE AND SCOPE .....</b>	<b>3</b>
<b>III.</b>	<b>SITE DESCRIPTION .....</b>	<b>3</b>
<b>IV.</b>	<b>METHODOLOGY .....</b>	<b>3</b>
A.	ASBESTOS.....	3
B.	LEAD-BASED PAINT .....	4
<b>V.</b>	<b>APPLICABLE REGULATIONS AND GUIDELINES .....</b>	<b>4</b>
A.	ASBESTOS.....	4
B.	LEAD-BASED PAINT .....	5
<b>VI.</b>	<b>RESULTS .....</b>	<b>6</b>
A.	ASBESTOS.....	6
B.	LEAD-BASED PAINT .....	8
<b>VII.</b>	<b>SITE OBSERVATIONS .....</b>	<b>9</b>
<b>VIII.</b>	<b>CONCLUSIONS AND RECOMMENDATIONS .....</b>	<b>9</b>
A.	ASBESTOS.....	9
B.	LEAD .....	10
<b>IX.</b>	<b>GENERAL .....</b>	<b>10</b>

## Appendices

Appendix A.....	Laboratory Analytical Results and Chain of Custody
Appendix B .....	XRF Data Sheets
Appendix C .....	Site Photographs
Appendix D.....	Site Sketch
Appendix E .....	Accreditations and Certifications

## **I. INTRODUCTION**

Mr. Mustafa Sahin M.Ed. of Magnolia Public Schools retained Clark Seif Clark, Inc. (CSC) to perform an asbestos-containing material (ACM) and Lead-Based Paint (LBP) survey for the proposed demolition of the vacant commercial property located at 7111 Winnetka Avenue in Canoga Park, California. Mr. Christian Goerrissen, (Cal/OSHA - CAC No. 00-2840 and California Department of Public Health (CDPH) Certified Lead Inspector/Assessor - CDPH No. 00000162) and Mr. Devon Charnley (Cal/OSHA CAC No. 11-6982 and CDPH No. 00006856) of CSC conducted the survey on October 24 and 25, 2022.

CSC's report is for the exclusive use of Magnolia Public Schools and applies only to the building referenced above or portion thereof. No one other than Magnolia Public Schools or those contracted by Magnolia Public Schools may utilize, reference, or otherwise rely on this report without prior written consent from CSC.

## **II. PURPOSE AND SCOPE**

The purpose of this investigation was to identify accessible ACM and LBP at the site that may be impacted by the proposed demolition activities at the site. CSC's scope of work included:

- A visual inspection of the readily accessible impacted areas at the site to evaluate the possible presence of ACM and LBP.
- Collection of bulk samples of suspect ACM and submittal of samples to a NVLAP accredited laboratory for analysis.
- Assessment of the condition of suspect ACM.
- Collection of x-ray fluorescence (XRF) reading of potential LBP.
- Assessment of the condition of potential LBP.
- Preparation of this report, which presents our data and summarizes the assessed materials

## **III. SITE DESCRIPTION**

The subject property is an approximately 22,000 square foot commercial building slated for demolition and redevelopment. In general the construction of the building consists of wood frame construction on a concrete slab foundation. The interior finishes consist of various vinyl floor coverings including vinyl floor tile, sheet vinyl flooring ceramic tile and carpeting. The interior demising walls are drywall; the ceilings are a suspended ceiling system with 2x4 lay in ceiling panels. There is spray applied fireproofing on the structural ceiling beams above the drop ceiling.

The exterior of the building contains ceramic floor and wall tiles, stucco wall texture and rock/tar built up roofing on a flat roof. The roof penetrations, seams and flashings are sealed with gray roof mastic.

The remainder of the property, which is 67,000 square feet in total, is covered with concrete walkways and asphalt paving.

## **IV. METHODOLOGY**

### **A. ASBESTOS**

Sampling of suspect-asbestos-containing materials was performed as required by the Asbestos Hazard Emergency Response Act (AHERA, 40 CFR Part 763, Appendix E to Subpart F) and the South Coast Air Quality Management District (SCAQMD, rule 1403).

Suspect asbestos materials were sampled and later identified using Polarized Light Microscopy (PLM) method in accordance with EPA Interim method for Determination of Asbestos in Bulk Samples (EPA/600/R-93/116, July 1993). The samples were submitted under proper chain of custody to EMSL Laboratory in Cinnaminson, New Jersey for analysis. The PLM Method is the most commonly used method to analyze building materials for the presence of asbestos. This method utilizes the optical properties of minerals to identify the selected constituent. The use of this method enables identification of the type and percentage of asbestos in a given sample. The PLM detection limit for asbestos identification is about one (1) percent asbestos. Because the State of California recognizes asbestos-containing building material (ACBM) as any material which contains greater than or equal to one tenth of one percent (.1) asbestos, materials containing "trace" amounts of asbestos are reported as ACBM in the State of California. The EPA, NESHAPS 40 CFR, M, recommends application of the more quantitative 400 Point Count Method when a sample material contains less than 10% asbestos by PLM. Documentation of laboratory results should be retained as a reference for general building safety and maintenance, and for any future renovation/ demolition activities.

## **B. LEAD-BASED PAINT**

Our inspector used a portable NITON-XLp 300 Series, XRF LBP Spectrum Analyzer manufactured by NITON Corporation to test for LBP. The LBP analyzer was equipped with 14 mCi, cadmium 109 sealed radioactive source. CSC calibrated the XRF pursuant to the manufacturer's specifications and regularly verified XRF readings against pre-determined lead samples produced by the National Institute of Standards and Testing (NIST). The calibration data is attached hereto.

The HUD Guidelines define X-Ray fluorescent analyzer (XRF) measurements greater than or equal to 1.0 mg/cm<sup>2</sup> (milligrams per square centimeter) or 5000 ppm (parts per million by weight) (0.5% by dry weight) using laboratory analysis, lead positive. For purposes of this inspection, all XRF readings equal to or greater than 0.7 mg/cm<sup>2</sup> are considered lead-based paint in accordance with the California Title 17 regulations and Los Angeles County guidelines. The Cal/OSHA "Lead in Construction" standard recognizes *any detectable (quantifiable)* concentrations of lead as regulated materials.

When performing lead-related construction activities, workers must be protected when exposed to levels above the current permissible exposure limit (PEL) of 50ug/cm<sup>2</sup>, regardless of the content of lead in paint.

## **V. APPLICABLE REGULATIONS AND GUIDELINES**

### **A. ASBESTOS**

CSC performed in accordance with SCAQMD Rule 1403, AHERA 40 CFR Part 763 and US EPA NESHAP 40 CFR 61, Subparts A and M.

The Asbestos Hazard Emergency Response Act (AHERA) 40 CFR Part 763, as implemented by the US EPA, Primarily pertains to the assessment and management of ACMs in Kindergarten through Grade 12, non-profit schools. However, many of the procedures, training requirements, and certifications defined by AHERA have become the industry standard for most other facilities. For this survey, CSC utilized AHERA protocols in the identification, assessment, and sampling of building materials suspected of containing asbestos.

U.S. EPA NESHAP regulations for asbestos apply to certain renovation and demolition projects in facilities containing ACM and/or assumed ACM. NESHAP usually requires all friable ACM and some categories of non-friable ACM be removed before a building is demolished, and may require localized removal before or as part of a demolition. For demolition projects where friable ACM will be disturbed, NESHAP may require appropriate

work practices or procedures for the control of emissions. The following U.S. EPA NESHAP definitions of ACM are very important in interpreting which NESHAP requirements may apply to the site building:

- *Friable asbestos-containing material*: any material containing more than one (1) percent asbestos that when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.
- *Category I non-friable asbestos-containing material*: asbestos-containing packings, gaskets, resilient floor covering, and asphalt roofing products containing more than one (1) percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- *Category II non-friable asbestos-containing material*: any material excluding Category I non-friable ACM, containing more than one (1) percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- *Regulated asbestos-containing material (RACM)*: (1) friable ACM, (2) Category I non-friable ACM that has become friable (3) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (4) Category II non-friable ACM that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the materials in the course of renovation or demolition operations regulated by NESHAP.

## **B. LEAD-BASED PAINT**

The US EPA, HUD, and CDPH define LBP as paint containing greater than 0.5% lead by weight or 5,000 parts per million (ppm) of total lead by laboratory analysis, or a lead content of 1.0 milligrams per square centimeter (mg/cm<sup>2</sup>) by XRF measurement. Federal OSHA and Cal/OSHA regulations (Lead Construction Standard) do not provide a definition for “lead-based paint” but refer to the US EPA, HUD, and CDPH criteria mentioned above. Cal/OSHA is primarily concerned with worker protection, and regulates any amount of lead contained within the coatings.

Both Federal OSHA and Cal/OSHA provide an Action Level (AL) of 30 micrograms per cubic meter (µg/m<sup>3</sup>) of airborne lead for an 8-hour, time-weighted average. Specific worker training and worker protection are to be provided by employers if workers are exposed to airborne lead at or above the AL. Additionally, both Federal OSHA and Cal/OSHA provide a Permissible Exposure Limit (PEL) for worker exposure to airborne lead particles of 50 µg/m<sup>3</sup> of air for an 8-hour, time-weighted average. According to Cal/OSHA (CCR Title 8, Section 1532.1), employers may assume that disturbance of coatings or materials shown to contain less than 0.06% lead by weight (equivalent to 600 ppm lead) will not result in exposures above the applicable AL as long as workers are not performing the Cal/OSHA designated “trigger tasks” (such as manual demolition, manual sanding or scraping, or abrasive blasting). However, demolition or demolition activities that include materials with lead in any concentration could, under certain circumstances, trigger Federal OSHA and Cal/OSHA regulations. The concentrations of airborne lead generated by disturbing paints at the Site would vary based upon several factors, including the type of activity (including “trigger tasks”) and the severity of disturbance to the building materials. Measurement of airborne lead concentrations would require air monitoring by a trained lead professional during the disturbance of building materials.

## VI. RESULTS

The following tables summarize the results of the testing performed during the site survey.

### A. ASBESTOS

A total of one hundred thirty five (135) bulk samples were collected and analyzed on a layer-by-layer basis using polarized light microscopy (PLM). Representative samples of all identified suspect asbestos-containing materials were collected and submitted for analysis; each distinguishable layer was analyzed individually by the laboratory. The following table summarizes the analytical results. A complete list of sample results can be found in Appendix A:

**Table 1: Bulk Sampling Results**

Sample No:	HM	Suspect Asbestos-Containing Materials	Asbestos Content	Location of Material (Homogenous area)	NESHAPS Condition/Friability	Quantity (ft <sup>2</sup> )*
7111 B1	1	Black 12" ceramic floor tile with grout and mortar	NAD	Main lobby floor	G/NF	1,000
7111 B2	2	Blue 12" ceramic floor tile with grout and mortar	NAD	Main lobby floor	P/NF	600
7111 B3 – B5	3	Beige 12" ceramic floor tile with grout and mortar	NAD	Suite 1 lobby and restrooms, suite 10	G/NF	1,700
7111 B6 – B7	4	White 6" ceramic tile with grout and mortar	NAD	Suite 16 restrooms on floors and walls	G/NF	200
7111 B8 – B10	5	Brown 4" ceramic tile with grout and mortar	NAD	Exterior floors and walls at north and east entrances	G/NF	2,000
7111 B11 – B16	6	Yellow carpet glue	NAD	Interior floors under carpet	G/NF	8,000
7111 B17 – B23	7	Concrete slab	NAD	Building slab	G/NF	22,000
7111 B24 – B25	8	Gray terrazzo print vinyl sheet flooring with tan mastic (top layer)	NAD	Corridor restrooms east of Suite 8	G/NF	60
<b>7111 B24 – B25</b>	<b>8</b>	<b>Beige vinyl sheet flooring with tan mastic (bottom layer)</b>	<b>15% Chrysotile</b>	<b>Corridor restrooms east of Suite 8, suite 8 reception restroom</b>	<b>G/NF</b>	<b>60</b>
7111 B26, 28, 29, 31, 35, 36	9	Blue gray terrazzo print vinyl sheet flooring with tan mastic (top layer)	NAD	Suite 9 restrooms, throughout Suite 4, suite 14 restrooms and janitor closet, north corridor janitors office, Go-Green suite under laminate	G/NF	2,500
<b>7111 B26, 28, 29, 31, 35, 36</b>	<b>9</b>	<b>Black floor tile mastic (bottom layer)</b>	<b>2%-3% Chrysotile</b>	<b>Suite 9 restrooms, throughout Suite 4, suite 14 restrooms and janitor closet, north corridor janitors office, Go-Green suite under laminate</b>	<b>G/NF</b>	<b>2,500</b>
7111 B27, 32-34	10	Gray 12" tile print vinyl sheet flooring with tan mastic (top layer)	NAD	Suite 20 bathroom floor	G/NF	40
7111 B27, 32-34	10	White vinyl floor tile with tan mastic (bottom layer)	NAD	Suite 20 bathroom floor	G/NF	40
<b>7111 B37-39, B42-44, B46-48, B54-56</b>	<b>11</b>	<b>Tan vinyl floor tile</b>	<b>2%-3% Chrysotile</b>	<b>Under laminate flooring in Suite 1, debris in Suite 14, under carpet in Suite 9, Suite 20 and in the janitors office</b>	<b>D/NF</b>	<b>15,000</b>

Sample No:	HM	Suspect Asbestos-Containing Materials	Asbestos Content	Location of Material (Homogenous area)	NESHAPS Condition/Friability	Quantity (ft <sup>2</sup> )*
<b>7111 B37-39, B42-44, B46-48, B54-56</b>	<b>11</b>	<b>Black floor tile mastic</b>	<b>2%-3% Chrysotile</b>	<b>Under laminate flooring in Suite 1, debris in Suite 14, under carpet in Suite 9, Suite 20 and in the janitors office</b>	<b>D/NF</b>	<b>15,000</b>
7111 B40 – B41	12	White 12” vinyl floor tile	NAD	Suite 1 Private under laminate	G/NF	1,400
<b>7111 B40 – B41</b>	<b>12</b>	<b>Black floor tile mastic</b>	<b>3% Chrysotile</b>	<b>Suite 1 Private under laminate</b>	<b>G/NF</b>	<b>1,400</b>
7111 B45	13	White 12” vinyl floor tile	NAD	Suite 9 office under laminate	G/NF	500
<b>7111 B45</b>	<b>13</b>	<b>Black floor tile mastic</b>	<b>2% Chrysotile</b>	<b>Suite 9 office under laminate</b>	<b>G/NF</b>	<b>500</b>
7111 B49 – B51	14	Beige 12” vinyl floor tile with yellow glue	NAD	Suite 16 Offices	G/NF	1,000
7111 B52 – B53	15	Beige 12” vinyl floor tile with black mastic	NAD	Suite 16 MRI room and MRI electrical room	G/NF	1,400
7111 B57 – B58	16	White 12” vinyl floor tile with yellow mastic (top layer)	NAD	Middle offices and network room	G/NF	280
<b>7111 B57 – B58</b>	<b>16</b>	<b>Tan vinyl floor tile (bottom layer)</b>	<b>2% Chrysotile</b>	<b>Middle offices and network room</b>	<b>G/NF</b>	<b>280</b>
<b>7111 B57 – B58</b>	<b>16</b>	<b>Black floor tile mastic (bottom layer)</b>	<b>3% Chrysotile</b>	<b>Middle offices and network room</b>	<b>G/NF</b>	<b>280</b>
7111 B59 – B68	17	4” vinyl base cove with adhesives (various colors)	NAD	Interior walls at base throughout building	G/NF	1,000
7111 B69	18	White 4” vinyl base cove with glue	NAD	Suite 20 bathroom	G/NF	10
7111 B70 – B84	19	Drywall system (skim coat/mud, drywall)	NAD	Interior walls throughout the building	G/NF	110,000
7111 B85 – B88	20	Drywall system (skim coat/mud, drywall)	NAD	Hard lid ceiling and columns above drop ceiling	G/NF	25,000
7111 B89 – B91	21	Wall panel adhesive	NAD	Suite 1 Private, north office on east wall (wood paneling)	G/NF	120
7111 B92 – B98	22	2x4 lay in ceiling panels	NAD	Interior ceilings throughout	G/F	40,000
7111 B99 – B103	23	Spray applied fireproofing	NAD	I-Beams above drop ceilings	G/F	5,000
7111 B104 – B107	24	Asphalt paving	NAD	Parking lots	G/NF	30,000
7111 B108 – B112	25	Concrete	NAD	Drain ditches, curbs, walkways and ramps	G/NF	3,000
7111 B113 – B117	26	Exterior stucco system	NAD	Exterior walls and soffits	G/NF	15,000
7111 B118	27	Stucco lath paper	NAD	Exterior walls and soffits	G/F	15,000
7111 B119	28	Wall caulk	NAD	At base of stucco walls at SW exterior	G/NF	10
7111 B120 – B122	29	Concrete masonry unit (CMU) walls with mortar	NAD	Perimeter walls and walls by trash dumpsters	G/NF	3,000
7111 B123 – B127	30	Rock/Tar roof core	NAD	Roof field and roof overhangs	G/NF	22,000



Sample No:	HM	Suspect Asbestos-Containing Materials	Asbestos Content	Location of Material (Homogenous area)	NESHAPS Condition/Friability	Quantity (ft <sup>2</sup> )*
7111 B128 – B131	31	Rolled asphalt roof core	NAD	Roof patches	G/NF	2,000
7111 B132 – B135	32	<i>Roof mastic</i>	<i>3% Chrysotile</i>	<i>Roof penetrations and flashings</i>	<i>G/NF</i>	<i>200</i>
HM = Homogeneous Material, NAD = No Asbestos Detected, G = Good D = Damaged SD = Significantly Damaged F = Friable NF = Non-friable * = Quantities are estimates of the amount of material affected by renovation/demolition and are not intended for bid purposes. Refer to the laboratory report and chain(s) of custody in Appendix A for complete list of materials tested and sampling locations						

Materials containing greater than one percent (>1%) asbestos as determined by Polarized Light Microscopy methodology are considered to be an asbestos-containing materials (ACM) according to the Environmental Protection Agency (EPA). These materials are subject to regulatory provisions under 40 CFR 61.

Any manufactured construction material containing greater than one tenth of one percent (>0.1%) asbestos as determined by Polarized Light Microscopy methodology are considered to be an asbestos-containing construction materials (ACCM) according to California Occupational Safety and Health Administration (Cal-OSHA). These materials are subject to regulatory provisions under CCR Title 8, Section 1529.

Should the demolition process reveal any additional suspect asbestos-containing materials; work must stop until the suspect materials are tested for asbestos content.

## B. LEAD-BASED PAINT

In Los Angeles County, paint is considered lead-based (LBP) if it tests greater than or equal to  $\geq 0.7$  mg/cm<sup>2</sup>, and paint is considered lead-containing (LCP) if it tests between 0.1 and 0.7 mg/cm<sup>2</sup>. The following are the analytical results of the testing combinations collected from the site:

**TABLE II: LBP Results**

Testing Combination / Locations	Substrate	Condition	Lead Status*	Lead Concentration (mg/cm <sup>2</sup> )	Inspection Notes
Interior walls	Drywall	Intact	NEG	0.0	Throughout building
Interior baseboards	Wood	Intact	NEG	0.0	Throughout building
Interior ceramic tile / bathrooms, lobby	Ceramic	Intact	NEG	0.0-0.5	
Interior bathroom fixtures	Porcelain	Intact	NEG	0.0	Throughout building
<i>Interior office wall with lead sheeting behind wood paneling / Suite 1 Private, north office wall</i>	<i>Wood / Lead</i>	<i>Intact</i>	<i>LBP</i>	<i>42.9</i>	<i>Elemental lead</i>
Interior windows, doors, door frames, trim	Wood	Intact	NEG	0.0-0.01	Throughout building
Exterior walls	Stucco	Intact	NEG	0.0	Throughout building

Testing Combination / Locations	Substrate	Condition	Lead Status*	Lead Concentration ( $\text{mg}/\text{cm}^2$ )	Inspection Notes
Exterior CMU walls	CMU	Intact	NEG	0.0	Throughout building
Exterior ceramic tile walls, columns, floor	Ceramic	Intact	NEG	0.0	Throughout building
Exterior parking lot striping	Asphalt / concrete	Intact	NEG	0.0	White, blue and red curbs
Exterior bollards	Metal / Concrete	Intact	NEG	0.0	Yellow
*LBM = Lead Based Material      LC = Lead-Containing      NEG = No Lead Detected above the regulatory limit Refer to the XRF Data Sheet(s) in Appendix B for a complete list of components and locations tested					

Note: Painted surfaces generally contain lead at various levels, which are lead containing and not considered lead-based paint. It is advised that all work where painted surfaces are impacted is conducted in a manner to minimize the generation of dust.

## VII. SITE OBSERVATIONS

CSC made the following noteworthy observations during the site visit on October 24 and 25, 2022.

1. The site survey was performed in advance of the planned demolition of all improvements on the subject property.
2. All suspect asbestos-containing materials were in good condition at the time of CSC's site investigation.
3. Black floor tile mastic, an asbestos-containing material, was observed on the concrete slab throughout most of the building; the material is present underneath the various floor coverings including the laminate, vinyl flooring and carpeting.
4. CSC performed destructive sampling throughout the property; however asbestos-containing materials may exist in areas that were not accessible through reasonable means.
5. CSC did not perform any underground investigation or testing; there is a likelihood that buried asbestos-containing utility pipes and lines exist underground on the property.

## VIII. CONCLUSIONS AND RECOMMENDATIONS

### A. ASBESTOS

Asbestos-containing materials are present at the site that will be impacted during the construction activities for the proposed demolition project. Since ACM is present, actions should be taken to prevent fiber release and to minimize exposure of the contractor and other subcontractors to asbestos fibers. The following recommendations should be followed for demolition projects including contracting the services of an environmental consultant to monitor/document that the contractor activities comply with OSHA, Cal-OSHA, US-EPA NESHAP, SCAQMD, and applicable city and county requirements:

- 1) A DOSH-licensed asbestos contractor shall remove the impacted ACM's from the demolition areas prior to initiating any demolition activities that could result in an uncontrolled asbestos fiber release.
- 2) The disposal of asbestos waste shall be in accord with applicable regulations of the U.S. EPA, U.S. DOT, California DOSH and SCAQMD. Friable asbestos-containing waste, containing more than one (1) percent

asbestos must be handled, transported, and disposed of as hazardous waste in accordance with the California Environmental Protection Agency regulations contained in Title 22 CCR. ACCM containing one percent or less asbestos can be disposed as non-hazardous waste. However the waste disposal facility must be notified of the presence of asbestos in the waste. DOSH worker protection regulations for asbestos would still apply during handling of the waste.

3) The general contractor, subcontractors, and employees working on-site should be made aware of the locations of the ACM identified in this report and the possibility of concealed suspect ACM's that could be found during modification activities. They should be advised to not disturb the identified ACM.

## **B. LEAD**

For the lead-based paints and lead-containing materials that will be impacted during the construction activities for the proposed demolition project, all work impacting the lead containing materials shall be performed in compliance with applicable DOSH Title 8, CCR, Section 1532.1 lead regulations and with the most recent edition of all applicable federal, state, and local regulations, standards, and codes governing abatement, transport, and disposal of lead-containing/contaminated materials.

Disposal of all lead containing materials shall be in compliance with the following Title 22, CCR, Division 4.5, Chapter 11. The California Department of Toxic Substances Control (DTSC) regulates the disposal of hazardous wastes generated in California, including wastes that contain certain amounts of lead. DTSC limits for what constitutes a hazardous waste because of lead content are more stringent than RCRA limits.

## **IX. GENERAL**

The report is designed to aid the building owner, architect, construction manager, general contractors, and potential asbestos abatement contractors in locating ACM and /or assumed ACM, LBP and/or lead-containing paint, and universal waste. The quantities of materials identified in this report are only estimates and should not be used for bidding or developing costs for abatement. It should be the responsibility of the asbestos abatement contractor to calculate actual quantities and develop removal costs accordingly.

Should materials similar to those identified in this report or, other forms of suspect hazardous materials be discovered during the renovation process, the contractor should be instructed to cease all work activities which may initiate an exposure episode and notify the appropriate management personnel.

Clark Seif Clark, Inc. prepared this asbestos survey under contract with Magnolia Public Schools. No warranties expressed or implied, are made by Clark Seif Clark, Inc. or its employees as to the use of any information, apparatus, product or process disclosed in this report. Though reasonable efforts have been made to assure correctness, if a Contractor is employed he should bring any discrepancies to the immediate attention of Clark Seif Clark, Inc.

We have employed state-of-the-art practices to perform this analysis of risk and identification, but this evaluation is severely limited in scope to areas accessible to a visual inspection or through reasonable means of the areas evaluated. No demolition or product review was performed in attempts to reveal material compositions. Our services consist of professional opinions and recommendations made in accordance with generally accepted engineering principles and practices and are designed to provide an analytical tool to assist the client. Clark Seif Clark or those representing Clark Seif Clark bear no responsibility for the actual condition of the structure or safety of a site pertaining to asbestos and/or asbestos contamination regardless of the actions taken by the client.

Clark Seif Clark appreciated having the opportunity to inspect your property. If you have any questions regarding this survey or other environmental hazards, please don't hesitate to contact us at (818) 727-2553 or (800) 807-1118.

Written by,



Christian Goerrissen  
Certified Asbestos Consultant (CAC)  
Cal/OSHA CAC No. 00-2840  
CDPH Lead I/A No. LRC-00000162  
Clark Seif Clark, Inc.

Reviewed and endorsed by,



Devon Charnley  
Certified Asbestos Consultant (CAC)  
Cal/OSHA CAC No. 11-6982  
CDPH PM/ST No. 00006856 & 00010248  
Clark Seif Clark, Inc.

## **APPENDIX A**

### **LABORATORY ANALYTICAL RESULTS AND CHAIN OF CUSTODY**



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com/cinnasblab@EMSL.com>

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

Attention: Christian Goerrissen

Clark Seif Clark

PO Box 4299

Chatsworth, CA 91313

Phone: (818) 402-9844

Fax: (818) 727-2556

Received Date: 10/31/2022 9:00 AM

Analysis Date: 11/03/2022 - 11/05/2022

Collected Date: 10/24/2022

Project: 1031500 - Winnetka Offices - 7111 Winnetka Avenue, Canoga Park, CA

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B1-Ceramic Tile 042227413-0001	Hall Lobby Floor - Ceramic Tile System - Black 12" Tile	Gray Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
7111-B1-Grout 042227413-0001A	Hall Lobby Floor - Ceramic Tile System - Black 12" Tile	White Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
7111-B1-Mortar 042227413-0001B	Hall Lobby Floor - Ceramic Tile System - Black 12" Tile	White Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
7111-B2-Ceramic Tile 042227413-0002	Pharmacy Floor - Ceramic Tile System - Blue 12" Tile	Brown/Blue Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
7111-B2-Grout 042227413-0002A	Pharmacy Floor - Ceramic Tile System - Blue 12" Tile	Blue Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
7111-B2-Mortar 042227413-0002B	Pharmacy Floor - Ceramic Tile System - Blue 12" Tile	White Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
7111-B3-Ceramic Tile 042227413-0003	Suite 1 Lobby - Ceramic Tile System - Beige 12" Tile	Brown/Beige Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B3-Grout 042227413-0003A	Suite 1 Lobby - Ceramic Tile System - Beige 12" Tile	Beige Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B3-Mortar 042227413-0003B	Suite 1 Lobby - Ceramic Tile System - Beige 12" Tile	Gray Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B4-Ceramic Tile 042227413-0004	Suite 1 RR Floor - Ceramic Tile System - Beige 12" Tile	Beige Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B4-Grout 042227413-0004A	Suite 1 RR Floor - Ceramic Tile System - Beige 12" Tile	Beige Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B4-Mortar 042227413-0004B	Suite 1 RR Floor - Ceramic Tile System - Beige 12" Tile	Gray Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B5-Ceramic Tile 042227413-0005	Suite 10 Floor - Ceramic Tile System - Beige 12" Tile	Brown/Beige Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B5-Grout 042227413-0005A	Suite 10 Floor - Ceramic Tile System - Beige 12" Tile	Brown Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B5-Mortar 042227413-0005B	Suite 10 Floor - Ceramic Tile System - Beige 12" Tile	White Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
7111-B6-Ceramic Tile 042227413-0006	Suite 16 RR Floor - Ceramic Tile System - White 6" Tile	White Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B6-Grout 042227413-0006A	Suite 16 RR Floor - Ceramic Tile System - White 6" Tile	Beige Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B6-Mortar 042227413-0006B	Suite 16 RR Floor - Ceramic Tile System - White 6" Tile	White Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B7-Ceramic Tile 042227413-0007	Suite 16 RR Walls - Ceramic Tile System - White 6" Tile	White Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B7-Grout 042227413-0007A	Suite 16 RR Walls - Ceramic Tile System - White 6" Tile	White Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B7-Mortar 042227413-0007B	Suite 16 RR Walls - Ceramic Tile System - White 6" Tile	Beige Non-Fibrous Homogeneous	HA: 4	100% Non-fibrous (Other)	None Detected
7111-B8-Ceramic Tile 042227413-0008	Exterior at North Entry Floor - Ceramic Tile System - Brown 4" Tile	Brown Non-Fibrous Homogeneous	HA: 5	100% Non-fibrous (Other)	None Detected
7111-B8-Grout 042227413-0008A	Exterior at North Entry Floor - Ceramic Tile System - Brown 4" Tile	Tan Non-Fibrous Homogeneous	HA: 5	100% Non-fibrous (Other)	None Detected
7111-B8-Mortar 042227413-0008B	Exterior at North Entry Floor - Ceramic Tile System - Brown 4" Tile	Gray Non-Fibrous Homogeneous	HA: 5	100% Non-fibrous (Other)	None Detected
7111-B9-Ceramic Tile 042227413-0009	Exterior at East Entry Floor - Ceramic Tile System - Brown 4" Tile	Brown Non-Fibrous Homogeneous	HA: 5	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B9-Grout 042227413-0009A	Exterior at East Entry Floor - Ceramic Tile System - Brown 4" Tile	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
7111-B9-Mortar 042227413-0009B	Exterior at East Entry Floor - Ceramic Tile System - Brown 4" Tile	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
7111-B10-Ceramic Tile 042227413-0010	Exterior at East Entry Walls - Ceramic Tile System - White 4" Tile	Brown/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
7111-B10-Grout 042227413-0010A	Exterior at East Entry Walls - Ceramic Tile System - White 4" Tile	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
7111-B10-Mortar 042227413-0010B	Exterior at East Entry Walls - Ceramic Tile System - White 4" Tile				Layer Not Present
			HA: 5		
7111-B11 042227413-0011	Under Carpets - Corridor by STE 8 - Yellow Carpet Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B12 042227413-0012	Under Carpets - Corridor by STE 16 - Yellow Carpet Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B13 042227413-0013	Under Carpets Suite 16 Lobby - Yellow Carpet Glue	Black/Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B14 042227413-0014	Under Carpets by SE Entry - Yellow Carpet Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B15 042227413-0015	Under Carpets by Suite 14 - Yellow Carpet Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B16 042227413-0016	Under Carpets by Suite 20 - Yellow Carpet Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
7111-B17 042227413-0017	Building Slab - North at STE 1 - Concrete Slab	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 7		
7111-B18 042227413-0018	Building Slab - NE At Ste 16 - Concrete Slab	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 7		

Initial report from: 11/07/2022 10:50:29





# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B19 042227413-0019	Building Slab - East At Ste 3 - Concrete Slab	Gray Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B20 042227413-0020	Building Slab - Center at Ste 8 - Concrete Slab	Gray Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B21 042227413-0021	Building Slab - North at STE 1 - Concrete Slab	Gray Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B22 042227413-0022	Building Slab - West at STE 20 - Concrete Slab	Gray Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B23-Concrete 042227413-0023	Building Slab - NW at STE 20 - Concrete Slab	Gray Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B23-Glue 042227413-0023A	Building Slab - NW at STE 20 - Concrete Slab	Brown Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
7111-B24-VSF 042227413-0024	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Gray Fibrous Homogeneous	HA: 8 15% Cellulose	85% Non-fibrous (Other)	None Detected
7111-B24-Mastic 042227413-0024A	Corridor Restrooms East of Suite 8 - Mastic	Tan Non-Fibrous Homogeneous	HA: 8	100% Non-fibrous (Other)	None Detected
7111-B24-VSF 2 042227413-0024B	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Tan Fibrous Homogeneous	HA: 8 10% Cellulose	75% Non-fibrous (Other)	15% Chrysotile
7111-B24-Mastic 2 042227413-0024C	Corridor Restrooms East of Suite 8 - Mastic	Tan Non-Fibrous Homogeneous	HA: 8	100% Non-fibrous (Other)	None Detected
7111-B24-VSF 3 042227413-0024D	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Blue/Beige Fibrous Homogeneous	HA: 8 15% Cellulose	85% Non-fibrous (Other)	None Detected
7111-B25-VSF 042227413-0025	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Gray Fibrous Homogeneous	HA: 8 15% Cellulose	85% Non-fibrous (Other)	None Detected
7111-B25-Mastic 042227413-0025A	Corridor Restrooms East of Suite 8 - Mastic	Tan Non-Fibrous Homogeneous	HA: 8	100% Non-fibrous (Other)	None Detected
7111-B25-VSF 2 042227413-0025B	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Tan Fibrous Homogeneous	HA: 8 10% Cellulose	75% Non-fibrous (Other)	15% Chrysotile

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B25-Mastic 2 042227413-0025C	Corridor Restrooms East of Suite 8 - Mastic	Tan Non-Fibrous Homogeneous	HA: 8	100% Non-fibrous (Other)	None Detected
7111-B25-VSF 3 042227413-0025D	Corridor Restrooms East of Suite 8 - Gray Terrazzo Print VSF	Blue/Beige Fibrous Homogeneous	HA: 8	15% Cellulose 85% Non-fibrous (Other)	None Detected
7111-B26-VSF 042227413-0026	Suite 9 Restroom - Blue and Gray Terrazzo Print VSF	White/Blue Fibrous Homogeneous	HA: 9	15% Cellulose 85% Non-fibrous (Other)	None Detected
7111-B26-Mastic 042227413-0026A	Suite 9 Restroom - Mastic	Tan Non-Fibrous Homogeneous	HA: 9	100% Non-fibrous (Other)	None Detected
7111-B26-VSF 2 042227413-0026B	Suite 9 Restroom - Blue and Gray Terrazzo Print VSF	Tan Fibrous Homogeneous	HA: 9	15% Cellulose 85% Non-fibrous (Other)	None Detected
7111-B26-Mastic 2 042227413-0026C	Suite 9 Restroom - Blue and Gray Terrazzo Print VSF	Black Non-Fibrous Homogeneous	HA: 9	97% Non-fibrous (Other)	3% Chrysotile
7111-B27-VSF 042227413-0027	Suite 1 Lobby Recetion Area - Gray 12" Tile Print VSF	Gray Fibrous Homogeneous	HA: 10	10% Glass 90% Non-fibrous (Other)	None Detected
7111-B27-Mastic 042227413-0027A	Suite 1 Lobby Recetion Area - Mastic	Yellow Non-Fibrous Homogeneous	HA: 10	100% Non-fibrous (Other)	None Detected
7111-B27-VFT 042227413-0027B	Suite 1 Lobby Recetion Area - VFT	Tan Non-Fibrous Homogeneous	HA: 10	100% Non-fibrous (Other)	None Detected
7111-B27-Mastic 2 042227413-0027C	Suite 1 Lobby Recetion Area - Mastic	Black Non-Fibrous Homogeneous	HA: 10	97% Non-fibrous (Other)	3% Chrysotile
7111-B28-VSF 042227413-0028	Suite 4 Room 3 all Exam Room - Blue and Gray Terrazzo Print VSF	Gray/Blue Fibrous Homogeneous	HA: 9	15% Synthetic 85% Non-fibrous (Other)	None Detected
7111-B28-Mastic 042227413-0028A	Suite 4 Room 3 all Exam Room - Mastic	Tan Non-Fibrous Homogeneous	HA: 9	100% Non-fibrous (Other)	None Detected
7111-B28-VFT 042227413-0028B	Suite 4 Room 3 all Exam Room - Vinyl Floor	Tan Non-Fibrous Homogeneous	HA: 9	98% Non-fibrous (Other)	2% Chrysotile
7111-B28-Mastic 2 042227413-0028C	Suite 4 Room 3 all Exam Room - Mastic	Black Non-Fibrous Homogeneous	HA: 9	97% Non-fibrous (Other)	3% Chrysotile

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B29-VSF 042227413-0029	Suite 4 Room 3 all Exam Room - Blue and Gray Terrazzo Print VSF	Gray/Blue Fibrous Homogeneous	15% Synthetic  HA: 9	85% Non-fibrous (Other)	None Detected
7111-B29-Mastic 042227413-0029A	Suite 4 Room 3 all Exam Room - Mastic	Tan Non-Fibrous Homogeneous	  HA: 9	100% Non-fibrous (Other)	None Detected
7111-B29-VSF 042227413-0029B	Suite 4 Room 3 all Exam Room - Blue and Gray Terrazzo Print VSF	Tan Non-Fibrous Homogeneous	  HA: 9	98% Non-fibrous (Other)	2% Chrysotile
7111-B29-Mastic 2 042227413-0029C	Suite 4 Room 3 all Exam Room - Blue and Gray Terrazzo Print VSF	Black Non-Fibrous Homogeneous	  HA: 9	97% Non-fibrous (Other)	3% Chrysotile
7111-B30-VSF 042227413-0030	Suite 8 Reception Restroom - Gray Terrazzo Print VSF	Gray Fibrous Homogeneous	15% Synthetic  HA: 8	85% Non-fibrous (Other)	None Detected
7111-B30-Mastic 042227413-0030A	Suite 8 Reception Restroom - Mastic	Tan Non-Fibrous Homogeneous	  HA: 8	100% Non-fibrous (Other)	None Detected
7111-B30-VSF 2 042227413-0030B	Suite 8 Reception Restroom - Gray Terrazzo Print VSF	White/Blue Fibrous Homogeneous	15% Cellulose  HA: 8	85% Non-fibrous (Other)	None Detected
7111-B30-Mastic 2 042227413-0030C	Suite 8 Reception Restroom - Mastic	Tan Non-Fibrous Homogeneous	  HA: 8	100% Non-fibrous (Other)	None Detected
7111-B30-VSF 3 042227413-0030D	Suite 8 Reception Restroom - Gray Terrazzo Print VSF	Tan Fibrous Homogeneous	10% Cellulose  HA: 8	75% Non-fibrous (Other)	15% Chrysotile
7111-B30-Mastic 3 042227413-0030E	Suite 8 Reception Restroom - Mastic	Tan Non-Fibrous Homogeneous	  HA: 8	100% Non-fibrous (Other)	None Detected
7111-B31-VSF 042227413-0031	Suite 14 Restrooms and Janitor Closet - Blue and Gray Terrazzo Print VSF	Gray/Blue Fibrous Homogeneous	15% Synthetic  HA: 9	85% Non-fibrous (Other)	None Detected
7111-B31-Mastic 042227413-0031A	Suite 14 Restrooms and Janitor Closet - MasticSF	Tan Non-Fibrous Homogeneous	  HA: 9	100% Non-fibrous (Other)	None Detected
7111-B31-VFT 042227413-0031B	Suite 14 Restrooms and Janitor Closet - VFT	Tan Non-Fibrous Homogeneous	  HA: 9	98% Non-fibrous (Other)	2% Chrysotile
7111-B31-Mastic 2 042227413-0031C	Suite 14 Restrooms and Janitor Closet - Mastic	Black Non-Fibrous Homogeneous	  HA: 9	97% Non-fibrous (Other)	3% Chrysotile

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

			Non-Asbestos		Asbestos
Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Type
HA: 9					
7111-B32-VSF	Suite 20 Bathroom Floor - Tan Stone Tile Print VSF	Tan Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
042227413-0032					
HA: 10					
7111-B32-Mastic	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0032A					
HA: 10					
7111-B32-VFT	Suite 20 Bathroom Floor - VFT	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0032B					
HA: 10					
7111-B32-Mastic 2	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0032C					
HA: 10					
7111-B33-VSF	Suite 20 Bathroom Floor - Tan Stone Tile Print VSF	Tan Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
042227413-0033					
HA: 10					
7111-B33-Mastic	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0033A					
HA: 10					
7111-B33-VFT	Suite 20 Bathroom Floor - VFT	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0033B					
HA: 10					
7111-B33-Mastic 2	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0033C					
HA: 10					
7111-B34-VSF	Suite 20 Bathroom Floor - Tan Stone Tile Print VSF	Tan Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
042227413-0034					
HA: 10					
7111-B34-Mastic	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0034A					
HA: 10					
7111-B34-VFT	Suite 20 Bathroom Floor - VFT	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0034B					
HA: 10					
7111-B34-Mastic 2	Suite 20 Bathroom Floor - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0034C					
HA: 10					
7111-B35-VSF	Go Green Middle Office under Laminate - Blue and Gray Terrazzo	Gray/Blue Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
042227413-0035					
HA: 9					
7111-B35-Mastic	Go Green Middle Office under Laminate - Mastic	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
042227413-0035A					
HA: 9					

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B35-VFT 042227413-0035B	Go Green Middle Office under Laminate - Blue and Gray Terrazzo	Tan Non-Fibrous Homogeneous	HA: 9	98% Non-fibrous (Other)	2% Chrysotile
7111-B35-Mastic 2 042227413-0035C	Go Green Middle Office under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 9	98% Non-fibrous (Other)	2% Chrysotile
7111-B36-VSF 042227413-0036	North Corridor Janitors Room Office - Blue and Gray Terrazzo	Gray/Blue Fibrous Homogeneous	5% Cellulose 2% Glass HA: 9	93% Non-fibrous (Other)	None Detected
7111-B36-Mastic 042227413-0036A	North Corridor Janitors Room Office - Mastic	Brown Non-Fibrous Homogeneous	HA: 9	100% Non-fibrous (Other)	None Detected
7111-B37-VFT 042227413-0037	Suite Offices under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B37-Mastic 042227413-0037A	Suite Offices under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	97% Non-fibrous (Other)	3% Chrysotile
7111-B37-Glue 042227413-0037B	Suite Offices under Laminate - Glut	Yellow Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B38-VFT 042227413-0038	Suite 1 Exam Room under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B38-Mastic 042227413-0038A	Suite 1 Exam Room under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B38-Glue 042227413-0038B	Suite 1 Exam Room under Laminate - Glue	Yellow Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B39-VFT 042227413-0039	Suite 1 Private Corridor under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B39-Mastic 042227413-0039A	Suite 1 Private Corridor under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B39-Glue 042227413-0039B	Suite 1 Private Corridor under Laminate - Glue	Yellow Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B40-VFT 042227413-0040	Suite 1 Private Room under Laminate - White 12 x 12 VFT	White Non-Fibrous Homogeneous	HA: 12	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B40-Adhesive 042227413-0040A	Suite 1 Private Room under Laminate - Adhesive	Tan Non-Fibrous Homogeneous	HA: 12	100% Non-fibrous (Other)	None Detected
7111-B41-VFT 042227413-0041	Suite 1 Private North Office under Laminate - White 12 x 12 VFT	White Non-Fibrous Homogeneous	HA: 12	100% Non-fibrous (Other)	None Detected
7111-B41-Adhesive 042227413-0041A <i>Result includes inseparable black mastic.</i>	Suite 1 Private North Office under Laminate - Adhesive	Tan/Black Non-Fibrous Homogeneous	HA: 12	97% Non-fibrous (Other)	3% Chrysotile
7111-B42-VFT 042227413-0042	Suite 1 Private North Office under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B42-Glue 042227413-0042A	Suite 1 Private North Office under Laminate - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B42-Mastic 042227413-0042B	Suite 1 Private North Office under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B43-VFT 042227413-0043	Suite 3 Exam Rooms under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B43-Glue 042227413-0043A	Suite 3 Exam Rooms under Laminate - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B43-Mastic 042227413-0043B	Suite 3 Exam Rooms under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B44-VFT 042227413-0044	Suite 3 Lab Area under Laminate - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B44-Glue 042227413-0044A	Suite 3 Lab Area under Laminate - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B44-Mastic 042227413-0044B	Suite 3 Lab Area under Laminate - Mastic	Black Non-Fibrous Homogeneous	HA: 11	96% Non-fibrous (Other)	4% Chrysotile
7111-B45-VFT 042227413-0045	Suite 9 Office under Laminate - VFT	White Non-Fibrous Homogeneous	HA: 13	100% Non-fibrous (Other)	None Detected
7111-B45-Mastic 042227413-0045A <i>Result includes inseparable black mastic.</i>	Suite 9 Office under Laminate - Mastic	Tan/Black Non-Fibrous Homogeneous	HA: 13	98% Non-fibrous (Other)	2% Chrysotile

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B46-VFT 042227413-0046	Suite 14 Scattered Debris - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B46-Mastic 042227413-0046A	Suite 14 Scattered Debris - Mastic	Black Non-Fibrous Homogeneous	HA: 11	97% Non-fibrous (Other)	3% Chrysotile
7111-B46-Glue 042227413-0046B	Suite 14 Scattered Debris - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B47-VFT 042227413-0047	Suite 14 Scattered Debris - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B47-Mastic 042227413-0047A	Suite 14 Scattered Debris - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B47-Glue 042227413-0047B	Suite 14 Scattered Debris - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B48-VFT 042227413-0048	Suite 14 Scattered Debris - VFT	Tan Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B48-Mastic 042227413-0048A	Suite 14 Scattered Debris - Mastic	Black Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B48-Glue 042227413-0048B	Suite 14 Scattered Debris - VFT	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B49-VFT 042227413-0049	Suite 16 Offices - Beige 12 x 12 VFT	Beige Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B49-Glue 042227413-0049A	Suite 16 Offices - Yellow Glue	Yellow Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B50-VFT 042227413-0050	Suite 16 Offices - Beige 12 x 12 VFT	Beige Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B50-Glue 042227413-0050A	Suite 16 Offices - Yellow Glue	Yellow Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B50-VFT 2 042227413-0050B	Suite 16 Offices - VFT	Gray/Tan Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected

Result includes inseparable tan mastic.

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B51-VFT 042227413-0051	Suite 16 Offices - Beige 12 x 12 VFT	Beige Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B51-Glue 042227413-0051A	Suite 16 Offices - Yellow Glue	Yellow Non-Fibrous Homogeneous	HA: 14	100% Non-fibrous (Other)	None Detected
7111-B52-VFT 042227413-0052	Suite 16 MRI Room - Beige 12 x 12 VFT	Beige Non-Fibrous Homogeneous	HA: 15	100% Non-fibrous (Other)	None Detected
7111-B52-Mastic 042227413-0052A	Suite 16 MRI Room - Mastic	Black Non-Fibrous Homogeneous	HA: 15	100% Non-fibrous (Other)	None Detected
7111-B53-VFT 042227413-0053	Suite 16 MRI Electrical Room - Beige 12 x 12 VFT	Beige Non-Fibrous Homogeneous	HA: 15	100% Non-fibrous (Other)	None Detected
7111-B53-Mastic 042227413-0053A	Suite 16 MRI Electrical Room - Mastic	Black Non-Fibrous Homogeneous	HA: 15	100% Non-fibrous (Other)	None Detected
7111-B54-VFT 042227413-0054	Corridor by Ste 9 under Carpet - VFT	White Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B54-Glue 042227413-0054A	Corridor by Ste 9 under Carpet - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B54-Mastic 042227413-0054B	Corridor by Ste 9 under Carpet - Mastic	Black Non-Fibrous Homogeneous	HA: 11	97% Non-fibrous (Other)	3% Chrysotile
7111-B55-VFT 042227413-0055	Corridor by Ste 9 under Carpet - VFT	White Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B55-Glue 042227413-0055A	Corridor by Ste 9 under Carpet - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected
7111-B55-Mastic 042227413-0055B	Corridor by Ste 9 under Carpet - Mastic	Black Non-Fibrous Homogeneous	HA: 11	97% Non-fibrous (Other)	3% Chrysotile
7111-B56-VFT 042227413-0056	Corridor by Suite 20 under Carpet - VFT	White Non-Fibrous Homogeneous	HA: 11	98% Non-fibrous (Other)	2% Chrysotile
7111-B56-Glue 042227413-0056A	Corridor by Suite 20 under Carpet - Glue	Tan Non-Fibrous Homogeneous	HA: 11	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29





# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B56-Mastic 042227413-0056B	Corridor by Suite 20 under Carpet - Mastic	Black Non-Fibrous Homogeneous	HA: 11	97% Non-fibrous (Other)	3% Chrysotile
7111-B57-VFT 042227413-0057	Middle Office - White 12 x 12 VFT	White Non-Fibrous Homogeneous	HA: 16	100% Non-fibrous (Other)	None Detected
7111-B57-Glue 042227413-0057A	Middle Office - Glue	Yellow Non-Fibrous Homogeneous	HA: 16	100% Non-fibrous (Other)	None Detected
7111-B58-VFT 042227413-0058	Network Room - White 12 x 12 VFT	White Non-Fibrous Homogeneous	HA: 16	100% Non-fibrous (Other)	None Detected
7111-B58-Glue 042227413-0058A	Network Room - Glue	Yellow Non-Fibrous Homogeneous	HA: 16	100% Non-fibrous (Other)	None Detected
7111-B58-VSF 042227413-0058B	Network Room - VSF	Various/Yellow/Green Fibrous Homogeneous	25% Cellulose HA: 16	75% Non-fibrous (Other)	None Detected
Result includes analysis of inseparable mastic.					
7111-B58-VFT 2 042227413-0058C	Network Room - VFT	Tan Non-Fibrous Homogeneous	HA: 16	98% Non-fibrous (Other)	2% Chrysotile
7111-B58-Mastic 042227413-0058D	Network Room - Mastic	Black Non-Fibrous Homogeneous	HA: 16	97% Non-fibrous (Other)	3% Chrysotile
7111-B59-Base Cove 042227413-0059	Interior Walls at Base Suite 4 - Blue 4" Vinyl Base Cove	Blue Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B59-Glue 042227413-0059A	Interior Walls at Base Suite 4 - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B60-Base Cove 042227413-0060	Interior Suite 4 Room 4 - Blue 4" Vinyl Base Cove	Blue Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B60-Glue 042227413-0060A	Interior Suite 4 Room 4 - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B61-VBC 042227413-0061	Interior Walls at Base - North Janitors Room - Blue 4" -VBC	Blue Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B61-Glue 042227413-0061A	Interior Walls at Base - North Janitors Room - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B62-VBC 042227413-0062	Interior Walls at Base - Corridor by SE Entry - Black 4" VBC	Black Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B62-Glue 042227413-0062A	Interior Walls at Base - Corridor by SE Entry - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B63-VBC 042227413-0063	Interior Walls at Base - Corridor by SE 8 - Black 4" VBC	Black Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B63-Glue 042227413-0063A	Interior Walls at Base - Corridor by SE 8 - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B64-VBC 042227413-0064	Interior Walls at Base - Corridor by SE 9 - Black 4" VBC	Black Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B64-Glue 042227413-0064A	Interior Walls at Base - Corridor by SE 9 - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B65-VBC 042227413-0065	Interior Walls at Base - Corridor by SE 14 - Black 4" VBC	Black Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B65-Glue 042227413-0065A	Interior Walls at Base - Corridor by SE 14 - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B66-VBC 042227413-0066	Interior Walls at Base - Suite 16 by Reception - Tan 4" VBC	Tan Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B66-Glue 042227413-0066A	Interior Walls at Base - Suite 16 by Reception - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B67-VBC 042227413-0067	Interior Walls at Base - Suite 16 Offices - Tan 4" VBC	Tan Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B67-Glue 042227413-0067A	Interior Walls at Base - Suite 16 Offices - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B68-VBC 042227413-0068	Interior Walls at Base - Network Room - Tan 4" VBC	Tan Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected
7111-B68-Glue 042227413-0068A	Interior Walls at Base - Network Room - Glue	White Non-Fibrous Homogeneous	HA: 17	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B69-VBC 042227413-0069	Interior Walls at Base - Suite 20 Bathroom - White 4" VBC	Tan Non-Fibrous Homogeneous	HA: 18	100% Non-fibrous (Other)	None Detected
7111-B69-Glue 042227413-0069A	Interior Walls at Base - Suite 20 Bathroom - Glue	White Non-Fibrous Homogeneous	HA: 18	100% Non-fibrous (Other)	None Detected
7111-B70-Drywall 042227413-0070	Interior Walls - East Lobby - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B70-Mud 042227413-0070A	Interior Walls - East Lobby - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B70-Tape 042227413-0070B	Interior Walls - East Lobby - Drywall System	Beige Fibrous Homogeneous	95% Cellulose HA: 19	5% Non-fibrous (Other)	None Detected
7111-B71-Drywall 042227413-0071	Interior Walls - South Lobby - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B71-Mud 042227413-0071A	Interior Walls - South Lobby - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B71-Tape 042227413-0071B	Interior Walls - South Lobby - Drywall System	Beige Fibrous Homogeneous	95% Cellulose HA: 19	5% Non-fibrous (Other)	None Detected
7111-B72-Drywall 042227413-0072	Interior Walls - South Lobby Ceiling - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B72-Mud 042227413-0072A	Interior Walls - South Lobby Ceiling - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B72-Tape 042227413-0072B	Interior Walls - South Lobby Ceiling - Drywall System	Beige Fibrous Homogeneous	95% Cellulose HA: 19	5% Non-fibrous (Other)	None Detected
7111-B73-Drywall 042227413-0073	Interior Walls - Corridor by Ste 16 - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B73-Mud 042227413-0073A	Interior Walls - Corridor by Ste 16 - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B73-Tape 042227413-0073B	Interior Walls - Corridor by Ste 16 - Drywall System	Beige Fibrous Homogeneous	95% Cellulose HA: 19	5% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B74-Drywall 042227413-0074	Interior Walls - SEW Corridor - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B74-Mud 042227413-0074A	Interior Walls - SEW Corridor - Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
7111-B74-Tape 042227413-0074B	Interior Walls - SEW Corridor - Drywall System	Beige Fibrous Homogeneous	95% Cellulose  HA: 19	5% Non-fibrous (Other)	None Detected
7111-B75-Drywall 042227413-0075	Interior Walls - Suite 3 Room 4 - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B75-Mud 042227413-0075A	Interior Walls - Suite 3 Room 4 - Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
7111-B75-Tape 042227413-0075B	Interior Walls - Suite 3 Room 4 - Drywall System	Beige Fibrous Homogeneous	95% Cellulose  HA: 19	5% Non-fibrous (Other)	None Detected
7111-B76-Drywall 042227413-0076	Interior Walls - Suite 4 Exam Room 1 - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B76-Mud 042227413-0076A	Interior Walls - Suite 4 Exam Room 1 - Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
7111-B77-Drywall 042227413-0077	Interior Walls - Suite 8 Reception - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B77-Mud 042227413-0077A	Interior Walls - Suite 8 Reception - Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
7111-B78-Drywall 042227413-0078	Interior Walls - Suite 14 Lobby - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B78-Mud 042227413-0078A	Interior Walls - Suite 14 Lobby - Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
7111-B78-Tape 042227413-0078B	Interior Walls - Suite 14 Lobby - Drywall System	Beige Fibrous Homogeneous	95% Cellulose  HA: 19	5% Non-fibrous (Other)	None Detected
7111-B79-Drywall 042227413-0079	Interior Walls - Suite 16 Office - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B79-Mud 042227413-0079A	Interior Walls - Suite 16 Office - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B79-Tape 042227413-0079B	Interior Walls - Suite 16 Office - Drywall System	Beige Fibrous Homogeneous	95% Cellulose HA: 19	5% Non-fibrous (Other)	None Detected
7111-B80-Drywall 042227413-0080	Interior Walls - Room 19 - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B80-Mud 042227413-0080A	Interior Walls - Room 19 - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B80-Drywall 2 042227413-0080B	Interior Walls - Room 19 - Drywall System	White Non-Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B80-Mud 2 042227413-0080C	Interior Walls - Room 19 - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B81-Drywall 042227413-0081	Interior Walls - Go Green Offices - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B81-Mud 042227413-0081A	Interior Walls - Go Green Offices - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B81-Skim Coat 042227413-0081B	Interior Walls - Go Green Offices - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B82-Drywall 042227413-0082	Interior Walls - Suite 20 Reception - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B82-Mud 042227413-0082A	Interior Walls - Suite 20 Reception - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B82-Skim Coat 042227413-0082B	Interior Walls - Suite 20 Reception - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected
7111-B83-Drywall 042227413-0083	Interior Walls - Room 20 - Drywall System	White Fibrous Homogeneous	10% Cellulose HA: 19	90% Non-fibrous (Other)	None Detected
7111-B83-Mud 042227413-0083A	Interior Walls - Room 20 - Drywall System	White Non-Fibrous Homogeneous	HA: 19	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com/cinnasblab@EMSL.com>

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B84-Drywall 042227413-0084	Interior Walls - Network Room - Drywall System	White Fibrous Homogeneous	10% Cellulose  HA: 19	90% Non-fibrous (Other)	None Detected
7111-B84-Mud 042227413-0084A	Interior Walls - Network Room - Drywall System	White Non-Fibrous Homogeneous	  HA: 19	100% Non-fibrous (Other)	None Detected
7111-B84-Tape 042227413-0084B	Interior Walls - Network Room - Drywall System	Beige Fibrous Homogeneous	95% Cellulose  HA: 19	5% Non-fibrous (Other)	None Detected
7111-B85-Drywall 042227413-0085	Hard Lid Ceiling and Columns above Drop Ceiling NW - Drywall System Ceilings		  HA: 20		Layer Not Present
7111-B85-Mud 042227413-0085A	Hard Lid Ceiling and Columns above Drop Ceiling NW - Drywall System Ceilings	White Non-Fibrous Homogeneous	  HA: 20	100% Non-fibrous (Other)	None Detected
7111-B86 042227413-0086	Hard Lid Ceiling and Columns above Drop Ceiling Center - Drywall System Ceilings	White Fibrous Homogeneous	10% Cellulose  HA: 20	90% Non-fibrous (Other)	None Detected
7111-B87-Drywall 042227413-0087	Hard Lid Ceiling and Columns above Drop Ceiling at Suite 14 - Drywall System Ceilings	White Fibrous Homogeneous	10% Cellulose  HA: 20	90% Non-fibrous (Other)	None Detected
7111-B87-Mud 042227413-0087A	Hard Lid Ceiling and Columns above Drop Ceiling at Suite 14 - Drywall System Ceilings	White Non-Fibrous Homogeneous	  HA: 20	100% Non-fibrous (Other)	None Detected
7111-B88-Drywall 042227413-0088	Hard Lid Ceiling and Columns above Drop Ceiling at Suite 4 - Drywall System Ceilings	White Fibrous Homogeneous	10% Cellulose  HA: 20	90% Non-fibrous (Other)	None Detected
7111-B88-Mud 042227413-0088A	Hard Lid Ceiling and Columns above Drop Ceiling at Suite 4 - Drywall System Ceilings	White Non-Fibrous Homogeneous	  HA: 20	100% Non-fibrous (Other)	None Detected
7111-B89 042227413-0089	Suite 1 Private N Office E Wall Wood Panel - Wall Panel Adhesive	Tan/Silver Non-Fibrous Homogeneous	  HA: 21	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B90 042227413-0090	Suite 1 Private N Office E Wall Wood Panel - Wall Panel Adhesive	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 21					
7111-B91 042227413-0091	Suite 1 Private N Office E Wall Wood Panel - Wall Panel Adhesive	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 21					
7111-B92 042227413-0092	Interior Ceilings - Main Lobby - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B93 042227413-0093	Interior Ceilings - Pharmacy - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B94 042227413-0094	Interior Ceilings - E Corridor - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B95 042227413-0095	Interior Ceilings - Suite 4 - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B96 042227413-0096	Interior Ceilings - Suite 20 - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B97 042227413-0097	Interior Ceilings - Suite 1 - 2 x 4 Lay-in Ceiling Panels	Tan Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B98 042227413-0098	Interior Ceilings - Suite 8 - 2 x 4 Lay-in Ceiling Panels	Gray Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
HA: 22					
7111-B99 042227413-0099	I Beams above Drop Ceiling - NW - Spray Applied Fireproofing	Brown Fibrous Homogeneous	70% Cellulose	30% Non-fibrous (Other)	None Detected
HA: 23					
7111-B100 042227413-0100	I Beams above Drop Ceiling - Center - Spray Applied Fireproofing	Brown Fibrous Homogeneous	70% Cellulose	30% Non-fibrous (Other)	None Detected
HA: 23					
7111-B101 042227413-0101	I Beams above Drop Ceiling - At Suite 14 - Spray Applied Fireproofing	Brown Fibrous Homogeneous	70% Cellulose	30% Non-fibrous (Other)	None Detected
HA: 23					
7111-B102 042227413-0102	I Beams above Drop Ceiling - At Suite 19 - Spray Applied Fireproofing	Brown Fibrous Homogeneous	70% Cellulose	30% Non-fibrous (Other)	None Detected
HA: 23					

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnaslab@EMSL.com](mailto:cinnaslab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B103 042227413-0103	I Beams above Drop Ceiling - SW at Suite 4 - Spray Applied Fireproofing	Brown Fibrous Homogeneous	70% Cellulose	30% Non-fibrous (Other)	None Detected
HA: 23					
7111-B104 042227413-0104	Parking Lot - North - Asphalt Paving	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 24					
7111-B105 042227413-0105	Parking Lot - South - Asphalt Paving	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 24					
7111-B106 042227413-0106	Parking Lot - SW - Asphalt Paving	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 24					
7111-B107 042227413-0107	Parking Lot - West - Asphalt Paving	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 24					
7111-B108 042227413-0108	North Side Drain Ditch - Concrete	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 25					
7111-B109 042227413-0109	East Side Curb - Concrete	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 25					
7111-B110 042227413-0110	East Walkway - Concrete	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 25					
7111-B111 042227413-0111	South Entry Ramp - Concrete	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 25					
7111-B112 042227413-0112	West Walkway - Concrete	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 25					
7111-B113-Texture 042227413-0113	Exterior Walls - North - Exterior Stucco System	Gray/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 26					
7111-B113-Stucco 042227413-0113A	Exterior Walls - North - Exterior Stucco System	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 26					
7111-B114-Texture 042227413-0114	Exterior Walls - Ceiling at N Entry - Exterior Stucco System	Gray/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 26					
7111-B114-Stucco 042227413-0114A	Exterior Walls - Ceiling at N Entry - Exterior Stucco System	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
HA: 26					

Initial report from: 11/07/2022 10:50:29





# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B115-Texture 042227413-0115	Exterior Walls - NE - Exterior Stucco System	Gray/White Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B115-Stucco 042227413-0115A	Exterior Walls - NE - Exterior Stucco System	Gray/White Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B116-Texture 042227413-0116	Exterior Walls - SW - Exterior Stucco System	Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B116-Stucco 042227413-0116A	Exterior Walls - SW - Exterior Stucco System	Gray Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B117-Texture 042227413-0117	Exterior Walls - West - Exterior Stucco System	White Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B117-Stucco 042227413-0117A	Exterior Walls - West - Exterior Stucco System	Gray Non-Fibrous Homogeneous	HA: 26	100% Non-fibrous (Other)	None Detected
7111-B118 042227413-0118	Behind Stucco Walls - SW Corner - Stucco Lath Paper	Brown/Black Fibrous Homogeneous	95% Cellulose HA: 27	5% Non-fibrous (Other)	None Detected
7111-B119 042227413-0119	At Base of Stucco Walls - SW Corner - Wall Caulk	White Non-Fibrous Homogeneous	HA: 28	100% Non-fibrous (Other)	None Detected
7111-B120-CMU 042227413-0120	North Perimeter Wall - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected
7111-B120-Mortar 042227413-0120A	North Perimeter Wall - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected
7111-B121-CMU 042227413-0121	West Perimeter Wall - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected
7111-B121-Grout 042227413-0121A	West Perimeter Wall - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected
7111-B122-CMU 042227413-0122	West by Trash Dumpsters - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected
7111-B122-Grout 042227413-0122A	West by Trash Dumpsters - CMU Wall with Mortar	Gray Non-Fibrous Homogeneous	HA: 29	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B123-Roofing 042227413-0123	Rof Field - NW - Roof Tar Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 30	80% Non-fibrous (Other)	None Detected
7111-B123-Tar 042227413-0123A	Rof Field - NW - Roof Tar Roof Core	Black Non-Fibrous Homogeneous	  HA: 30	100% Non-fibrous (Other)	None Detected
7111-B124-Roofing 042227413-0124	Rof Field - Center - Roof Tar Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 30	80% Non-fibrous (Other)	None Detected
7111-B124-Tar 042227413-0124A	Rof Field - Center - Roof Tar Roof Core	Black Non-Fibrous Homogeneous	  HA: 30	100% Non-fibrous (Other)	None Detected
7111-B125-Roofing 042227413-0125	Rof Field - SE - Roof Tar Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 30	80% Non-fibrous (Other)	None Detected
7111-B125-Tar 042227413-0125A	Rof Field - SE - Roof Tar Roof Core	Black Non-Fibrous Homogeneous	  HA: 30	100% Non-fibrous (Other)	None Detected
7111-B126-Roofing 042227413-0126	Rof Field - N Overhang - Roof Tar Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 30	80% Non-fibrous (Other)	None Detected
7111-B126-Tar 042227413-0126A	Rof Field - N Overhang - Roof Tar Roof Core	Black Non-Fibrous Homogeneous	  HA: 30	100% Non-fibrous (Other)	None Detected
7111-B127-Roofing 042227413-0127	Rof Field - E Overhang - Roof Tar Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 30	80% Non-fibrous (Other)	None Detected
7111-B127-Tar 042227413-0127A	Rof Field - E Overhang - Roof Tar Roof Core	Black Non-Fibrous Homogeneous	  HA: 30	100% Non-fibrous (Other)	None Detected
7111-B128-Shingle 042227413-0128	Northeast Patch over Roof and Tar - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Synthetic  HA: 31	80% Non-fibrous (Other)	None Detected
7111-B128-Tar 042227413-0128A	Northeast Patch over Roof and Tar - Rolled Asphalt Roof Core	Black Non-Fibrous Homogeneous	  HA: 31	100% Non-fibrous (Other)	None Detected
7111-B128-Roofing 042227413-0128B	Northeast Patch over Roof and Tar - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass  HA: 31	80% Non-fibrous (Other)	None Detected
7111-B129-Shingle 042227413-0129	Center Ditch - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Synthetic  HA: 31	80% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



# EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnaslab@EMSL.com](mailto:cinnaslab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

## Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
7111-B129-Tar 042227413-0129A	Center Ditch - Rolled Asphalt Roof Core	Black Non-Fibrous Homogeneous	HA: 31	100% Non-fibrous (Other)	None Detected
7111-B129-Roofing 042227413-0129B	Center Ditch - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass HA: 31	80% Non-fibrous (Other)	None Detected
7111-B130-Shingle 042227413-0130	Parapet at North Overhang - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass HA: 31	80% Non-fibrous (Other)	None Detected
7111-B130-Tar 042227413-0130A	Parapet at North Overhang - Rolled Asphalt Roof Core	Black Non-Fibrous Homogeneous	HA: 31	100% Non-fibrous (Other)	None Detected
7111-B130-Roofing 042227413-0130B	Parapet at North Overhang - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass HA: 31	80% Non-fibrous (Other)	None Detected
7111-B131-Shingle 042227413-0131	Edge Flashing at South Side - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass HA: 31	80% Non-fibrous (Other)	None Detected
7111-B131-Tar 042227413-0131A	Edge Flashing at South Side - Rolled Asphalt Roof Core	Black Non-Fibrous Homogeneous	HA: 31	100% Non-fibrous (Other)	None Detected
7111-B131-Roofing 042227413-0131B	Edge Flashing at South Side - Rolled Asphalt Roof Core	Black Fibrous Homogeneous	20% Glass HA: 31	80% Non-fibrous (Other)	None Detected
7111-B132 042227413-0132	Penetrations and Flashing - H Flashing - Roof Mastic	Black Non-Fibrous Homogeneous	HA: 32	100% Non-fibrous (Other)	None Detected
7111-B133 042227413-0133	Penetrations and Flashing - NW Penetration - Roof Mastic	Gray Non-Fibrous Homogeneous	HA: 32	100% Non-fibrous (Other)	None Detected
7111-B134 042227413-0134	Penetrations and Flashing - E Penetration - Roof Mastic	Black Non-Fibrous Homogeneous	HA: 32	97% Non-fibrous (Other)	3% Chrysotile
7111-B135 042227413-0135	Penetrations and Flashing - SE Penetration - Roof Mastic	Black Non-Fibrous Homogeneous	HA: 32	100% Non-fibrous (Other)	None Detected

Initial report from: 11/07/2022 10:50:29



## EMSL Analytical, Inc.

200 Route 130 North Cinnaminson, NJ 08077

Tel/Fax: (800) 220-3675 / (856) 786-5974

<http://www.EMSL.com> / [cinnasblab@EMSL.com](mailto:cinnasblab@EMSL.com)

EMSL Order: 042227413

Customer ID: CLAR53

Customer PO:

Project ID:

Analyst(s)

*Elijah Mayorga (75)*

*Liliveth Escamilla (66)*

*Lori Grenier (138)*

*William Bradford (17)*

Samantha Rundstrom, Laboratory Manager  
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method") but augmented with procedures outlined in the 1993 ("final") version of the method. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Las Vegas, NV NVLAP Lab Code 600140-0, AZ 0953, CA 3002, NV 050132018-1

Initial report from: 11/07/2022 10:50:29



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

5 DAYS

## Chain of Custody Form- Bulk Sampling

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	RECEIVED EMSL + LAHRS	1 of	9	
Job Name & Location			Customer Id No.			
Winnetka Offices			(1006444)			
7111 Winnetka Avenue			2022 OCT 31 AM 9:53			
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to:		
			ETSL			
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	CERAMIC TILE SYSTEM	1	MAIN LOBBY FLOOR	GOOD	NO	~1,000 LB
B1	- BLACK 12" TILE					
B2	- BLUE 12" TILE	2	PHARMACY FLOOR	POOR	NO	~6,000 LB
B3	- BEIGE 12" TILE	3	SUITE 1 LOBBY	GOOD	NO	~200 LB
B4	- BEIGE 12" TILE	3	SUITE 1 PRIVATE RR FLOOR	GOOD	NO	~200 LB
B5	- BEIGE 12" TILE	3	SUITE 10 FLOOR	FAIR	NO	~1,500 LB
B6	- WHITE 6" TILE	4	SUITE 16 RR FLOOR	GOOD	NO	~200 LB
B7	- WHITE 6" TILE	4	SUITE 16 RR WALLS	↓	↓	↓
B8	- BROWN 4" TILE	5	EXTERIOR AT NORTH ENTRY FLOOR	GOOD	NO	~2,000 LB
B9	- BROWN 4" TILE	5	EXTERIOR AT EAST ENTRY FLOOR	↓	↓	↓
B10	- WHITE 4" TILE	5	EXTERIOR AT EAST ENTRY WALLS	↓	↓	↓
B11	YELLOW CARPET GLUE	6	UNDER CARPETS	GOOD	NO	~3,000 LB
B12		6	- CORRIDOR BY STE 8	↓	↓	↓
B13		6	- CORRIDOR BY STE 16	↓	↓	↓
B14		6	- SUITE 16 LOBBY	↓	↓	↓
B15		6	- BY SE ENTRY	↓	↓	↓
		6	- BY SUITE 141	↓	↓	↓
CONDITION CODE		FRIABLE CODE	HOMOGENEOUS CODE		QUANTITY CODE	
G= GOOD D=	F= FAIR P= POOR	Y= YES N= NO	HA= HOMOGENEOUS MATERIAL		SF= Square Ft. LF= LINEAR Ft.	
INSPECTION COMMENTS:						
CERAMIC TILE SYSTEM = TILE, GROUT, MORTAR						
Relinquished By:			Date & Time			
			10-27-22 @ 4:45 PM			
Received By:			Date & Time			
			10/31/22 9:00 am			

Clark Seif Clark

1350



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

## Chain of Custody Form- Bulk Sampling

Requested Turn around time

5 Days

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	RECEIVED EDSCLAB 10/27/22	2	9	
Job Name & Location			Customer Id No.			
Winnetka Offices			(1006444)			
7111 Winnetka Avenue			2022 OCT 31 AM 9:53			
Canoga Park, CA						
Sample Analysis:		PLM – Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy		Lab Submitted to: EDSCL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	YELLOW CARPET	6	UTTER CARPETS	GOOD	NO	~8,000 LB
B16	GLUE		- CORRIDOR BY STE 20			
	CONCRETE SLABS	7	BUILDING SLABS	GOOD	NO	~22,000 LB
B17			- NORTH AT STE 1			
B18		7	- NE AT STE 10			
B19		7	- EAST AT STE 3			
B20		7	- CENTER AT STE 8			
B21		7	- CENTER AT STE 10			
B22		7	- WEST AT STE 20			
B23		7	- NW AT STE 20			
B24	GRAY TERRAZZO PRINT USE	8	CORRIDOR RESTROOMS EAST OF SUITE 8	GOOD	NO	60 LB
B25		8				
B26	BLUE/GRAY TERRAZZO PRINT USE	9	SUITE 9 RESTROOM	GOOD	NO	40 LB
B27	GRAY 12" TILE PRINT USE	10	SUITE 1 LOBBY / RECEPTION AREA	FAIR	NO	~200 LB
B28	BLUE/GRAY TERRAZZO PRINT USE	9	SUITE 4 ROOM 3 (ALL EXAM ROOMS)	GOOD	NO	~1,000 LB
B29		9				
B30	GRAY TERRAZZO PRINT USE	8	SUITE 8 RECEPTION RESTROOM	GOOD	NO	~60 LB
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD	F= FAIR	P= POOR	Y= YES	N= NO	HA= HOMOGENEOUS MATERIAL	SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS: USE = VINYL SHEET FLOORING						
ALL VINYL FLOORING SAMPLES ARE CORE SAMPLES WITH MULTIPLE LAYERS OF FLOORING AND ADHESIVES / MASTICS						
Relinquished By:			Date & Time			
			10/27/22 @ 4:45 PM			
Received By:			Date & Time			

Clark Seif Clark



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

## Chain of Custody Form- Bulk Sampling

5 DAYS

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + LAYERS	3 of	9	
Job Name & Location		Customer Id No.:				
Winnetka Offices		(1006444)				
7111 Winnetka Avenue		2022 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to: ETL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	BLUE/GRAY TERRAZZO	9	SUITE 14 RESTROOMS AND JANITOR CLOSET	GOOD	NO	~120 LB
B31	PRINT USF	10	SUITE 20 BATHROOM FLOOR	GOOD	NO	~40 LB
B32	TAN STONE TILE PRINT USF	10				
B33		10				
B34		10				
B35	BLUE/GRAY TERRAZZO	9	60 GREEN MIDDLE OFFICE (UNDER LAMINATE)	GOOD	NO	~1,000 LB
B36		9	NORTH CORRIDOR JANITORS ROOM (OFFICE)	GOOD	NO	~100 LB
B37	VFT WITH GLOBE AND MASTIC	11	SUITE 1 OFFICES (UNDER LAMINATE)	FAIR	NO	~10,000 LB
B38		11	SUITE 1 EXAM ROOMS (UNDER LAMINATE)			
B39		11	SUITE 1 PRIVATE CORRIDOR (UNDER LAMINATE)			
B40	WHITE 12x12 VFT W/ADHESIVE	12	SUITE 1 PRIVATE ROOM 1 (UNDER LAMINATE)	FAIR	NO	~1,400 LB
B41		12	SUITE 1 PRIVATE ROOM 3 (UNDER LAMINATE)			
B42	VFT WITH GLOBE AND MASTIC	11	SUITE 1 PRIVATE - NORTH OFFICE (UNDER LAMINATE)	FAIR	NO	~10,000 LB
B43		11	SUITE 3 EXAM ROOMS (UNDER LAMINATE)			
B44		11	SUITE 3 LAB AREA (UNDER LAMINATE)			
B45	WHITE 12x12 VFT W/MASTIC	13	SUITE 9 OFFICE (UNDER LAMINATE)	FAIR	NO	~500 LB
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD	F= FAIR	P= POOR	Y= YES	N= NO	HA= HOMOGENEOUS MATERIAL	SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:		VFT = VINYL FLOOR TILE				
		VINYL FLOORING, SAMPLES AND CORE SAMPLES WITH MULTIPLE LAYERS OF FLOOR TILE, GLOBE AND MASTIC				
Relinquished By:			Date & Time			
			10-27-22 @ 4:45 PM			
Received By:			Date & Time			

Clark Seif Clark





CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

5 DAYS

## Chain of Custody Form- Bulk Sampling

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerissen	10/24/22	135 + LAYERS	4	of	9
Job Name & Location		Customer ID No.				
Winnetka Offices		(1006444)				
7111 Winnetka Avenue		2021 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to:		
				ETSL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111 B46	UFF WITH GLOB AND MASTEL	11	SUITE 14 SCATTERED BERRIS	POOR	NO	~1.400 lb
B47	↓	11	↓	↓	↓	↓
B48	↓	11	↓	↓	↓	↓
B49	BEIGE 12x12 UFT w/ YELLOW GLOB	14	SUITE 16 OFFICES	GOOD	NO	~1.000 lb
B50	↓	14	↓	↓	↓	↓
B51	↓	14	↓	↓	↓	↓
B52	BEIGE 12x12 UFT w/ MASTEL	15	SUITE 16 MRI ROOM	FAIR	NO	~1.400 lb
B53	↓	15	SUITE 16 MRI ELECTRICAL ROOM	↓	↓	↓
B54	UFF WITH GLOB AND MASTEL	11	CORRIDOR BY STE 9 UNDER CARPET	POOR	NO	~3.000 lb
B55	↓	11	JANITORS OFFICE UNDER CARPET	↓	↓	↓
B56	↓	11	CORRIDOR BY SUITE 20 UNDER CARPET	↓	↓	↓
B57	WHITE 12x12 UFT w/ GLOB	16	MIDDLE OFFICE	GOOD	NO	~200 lb
B58	↓	16	NETWORK ROOM	GOOD	NO	~80 lb
B59	BLUE 4" VINYL BASE COVE w/ GLOB	17	INTERIOR WALLS AT BASE - SUITE 4 - TR 3	GOOD	NO	~1.000 lb
B60	↓	17	↓ - SUITE 4 - TR 4	↓	↓	↓
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD D	F= FAIR	P= POOR	Y= YES N= NO	HA= HOMOGENEOUS MATERIAL		SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:		VBC = VINYL BASE COVE				
Relinquished By:		Date & Time				
[Signature]		10-27-22 @ 4:45 PM				
Received By:		Date & Time				

Clark Seif Clark





CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

# Chain of Custody Form- Bulk Sampling

Requested Turn around time

5 DAYS

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + LAYERS	5	of	9
Job Name & Location		Customer Id No.: J.				
Winnetka Offices		(1006444)				
7111 Winnetka Avenue		2022 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to: EITSL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	BLUE 4" VBC WITH GLUE	17	INTERIOR WALLS AT BASE - N. JANITORS ROOM	GOOD	NO	1,000 LB
B61						
B62	BLACK 4" VBC WITH GLUE	17	- CORRIDOR BY SE ENTRY			
B63		17	- CORRIDOR BY STE 8			
B64		17	- CORRIDOR BY STE 9			
B65		17	- CORRIDOR BY STE 14			
B66	TAN 4" VBC WITH GLUE	17	- SUITE 16 RECEPTION			
B67		17	- SUITE 16 OFFICES			
B68		17	- NETWORK ROOM			
B69	WHITE 4" VBC WITH GLUE	18	- SUITE 20 BATHROOM	GOOD	YES	10 LB
B70	DRYWALL SYSTEM	19	INTERIOR WALLS - EAST LOBBY	GOOD	NO	110,000 LB
B71		19	- SOUTH LOBBY			
B72		19	- S. LOBBY CEILING			
B73		19	- CORRIDOR BY STE 16			
B74		19	- S. E-W CORRIDOR			
B75		19	- SUITE 3. ROOM 4			
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD	F= FAIR	P= POOR	Y= YES	N= NO	HA= HOMOGENEOUS MATERIAL	SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:		DRYWALL SYSTEM = SKIN COAT / MUD, DRYWALL				
Relinquished By:			Date & Time			
			10-27-22 @ 4:45 PM			
Received By:			Date & Time			

Clark Seif Clark



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

5 DAYS

## Chain of Custody Form- Bulk Sampling

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + LAYERS	6	of	9
Job Name & Location		Customer Id No.:				
Winnetka Offices		CINNAMON, H.J.				
7111 Winnetka Avenue		2022 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM – Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to:		
				ETISL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	DRYWALL SYSTEM	19	INTERIOR WALLS	GOOD	NO	110.00015
B76			- SUITE 4 EXAM RM 1			
B77		19	- SUITE 8 RECEPTION			
B78		19	- SUITE 14 LOBBY			
B79		19	- SUITE 16 OFFICE			
B80		19	- ROOM 19			
B81	DRYWALL SYSTEM	19	INTERIOR WALLS	GOOD	NO	110.00015
B82			- 60- STREET OFFICE			
B83		19	- SUITE 20 RECEPTION			
B84		19	- ROOM 20			
B85	DRYWALL SYSTEM	20	HARD LID CEILING & COLUMNS	GOOD	NO	25.00015
B86	(CEILING)	20	ABOVE DROP CEILING - T14			
B87		20	- CEILING			
B88		20	- AT SUITE 14			
B89	WALL PANEL ADHESIVE	21	SUITE 1 TRAVEL - IT OFFICE	GOOD	NO	120A
B90		21	E. WALL (WOOD PANEL)			
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD D	F= FAIR	P= POOR	Y= YES N= NO	HA= HOMOGENEOUS MATERIAL		SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:						
Relinquished By:						
Date & Time						
10-27-22 @ 4:45 PM						
Received By:						
Date & Time						

Clark Self Clark





CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

# Chain of Custody Form- Bulk Sampling

Requested Turn around time

5 DAYS

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + LAYERS	7	of	9
Job Name & Location		Customer ID No.:				
Winnetka Offices		(1006444)				
7111 Winnetka Avenue		2022 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to: ETS		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	WALL PANEL	21	SUITE 1 PRIVATE T.O. OFFICE	GOOD	NO	~120 lb
B91	ADHESIVE		E. WALL (WOOD PANEL)			
B92	2x4 LAM-111	22	INTERIOR CEILING	GOOD	YES	~20,000 lb
B92	CEILING PANELS		- MAIN LOBBY			
B93		22	- PHARMACY			
B94		22	- E. CORRIDOR			
B95		22	- SUITE 4			
B96		22	- SUITE 20			
B97		22	- SUITE 1			
B98		22	- SUITE 8			
B99	SPRAY APPLIED FIREPROOFING	23	I-BEAMS ABOVE DROP CEILING - NW	GOOD	YES	5,000 lb
B100		23	- CENTER			
B101		23	- AT SUITE 14			
B102		23	- TROOP 19			
B103		23	- SW AT SUITE 4			
B104	ASPHALT PAVING	24	PARKING LOTS	GOOD	NO	~10,000 lb
B105		24	- NORTH			
B105		24	- SOUTH			
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD	F= FAIR	P= POOR	Y= YES	N= NO	HA= HOMOGENEOUS MATERIAL	SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:						
Relinquished By: [Signature]						
Date & Time: 10-27-22 @ 4:45 PM						
Received By: [Signature]						
Date & Time:						

Clark Seif Clark



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

5 Days

## Chain of Custody Form- Bulk Sampling

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + Layers	8	of	9
Job Name & Location			Customer Id No.:			
Winnetka Offices			(1006444)			
7111 Winnetka Avenue			2022 OCT 31 AM 9:53			
Canoga Park, CA						
Sample Analysis:	PLM – Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to:		
			ETSL			
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111 B106	ASPHALT PAVING	24	PARKING LOTS - SW	GOOD	NO	10,000 lb
B107	✓	24	✓ - WEST	✓	✓	✓
B108	CONCRETE	25	NORTH SIDE DRAIN DITCH	GOOD	NO	3,000 lb
B109	✓	25	✓ EAST SIDE CUTS	✓	✓	✓
B110	✓	25	✓ EAST WALKWAY	✓	✓	✓
B111	✓	25	✓ SOUTH ENTRY PATIO	✓	✓	✓
B112	✓	25	✓ WEST WALKWAY	✓	✓	✓
B113	EXTERIOR STUCCO SYSTEM	26	EXTERIOR WALLS - NORTH	GOOD	NO	15,000 lb
B114	✓	26	✓ - CEILING AT N. ENTRY	✓	✓	✓
B115	✓	26	✓ - TIE	✓	✓	✓
B116	✓	26	✓ - SW	✓	✓	✓
B117	✓	26	✓ - WEST	✓	✓	✓
B118	STUCCO LATH PAPER	27	BEHIND STUCCO WALLS - SW CORNER	GOOD	YES	15,000 lb
B119	WALL CAULK	28	AT BASE OF STUCCO WALLS - SW CORNER	GOOD	NO	10 lb
✓ B120	CMU WALL WITH MORTAR	29	NORTH PERIMETER WALL	GOOD	NO	3,000 lb
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD D	F= FAIR	P= POOR	Y= YES N= NO	HA= HOMOGENEOUS MATERIAL		SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:		CMU = CONCRETE MASONRY UNIT				
Relinquished By:			Date & Time			
[Signature]			10-27-22 @ 4:45 PM			
Received By:			Date & Time			

Clark Seif Clark



CLARK SEIF CLARK, INC.  
HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

042227413

Requested Turn around time

5 DAYS

## Chain of Custody Form- Bulk Sampling

CSC Job #	Sampling By	Date Taken	# Samples	Page #	Total Pages	
1031500	Christian Goerrissen	10/24/22	135 + LAYERS	9 of 9	9	
Job Name & Location		Customer Id No.:				
Winnetka Offices		(1006444)				
7111 Winnetka Avenue		2022 OCT 31 AM 9:53				
Canoga Park, CA						
Sample Analysis:	PLM - Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy			Lab Submitted to: ETSL		
ID #	Material Description	HM	Location of Sample	Condition	Friable	Quantity
7111	CMU WALL WITH MORTAR	29	WEST PERIMETER WALL	GOOD	NO	~3000LBS
B122		29	WEST BY TRASH DUMPSTERS	✓	✓	✓
B123	ROCK/TAR ROOF CORE	30	ROOF FIELD - NW	GOOD	NO	~22,000LBS
B124		30	- CENTER	✓	✓	✓
B125		30	- SE	✓	✓	✓
B126		36	- W. OVERHANG	✓	✓	✓
B127		30	- E. OVERHANG	✓	✓	✓
B128	ROCKED ASPHALT ROOF CORE	31	NORTHEAST PATCH (OVER ROCK/TAR)	GOOD	NO	~2,000LBS
B129		31	CENTER PATCH	✓	✓	✓
B130		31	PATCH AT NORTH OVERHANG	✓	✓	✓
B131		31	EDGE FLASHING AT SOUTH SIDE	✓	✓	✓
B132	ROOF MASTIC	32	PENETRATIONS AND FLASHINGS - N FLASHING	FAIR	NO	~200LBS
B133		32	- NW PENETRATION	✓	✓	✓
B134		32	- E. PENETRATION	✓	✓	✓
B135		32	- SE PENETRATION	✓	✓	✓
CONDITION CODE		FRIABLE CODE		HOMOGENEOUS CODE		QUANTITY CODE
G= GOOD D	F= FAIR	P= POOR	Y= YES N= NO	HA= HOMOGENEOUS MATERIAL		SF= Square Ft. LF= LINEAR Ft.
INSPECTION COMMENTS:						
Relinquished By: [Signature]						
Date & Time: 10-27-22 @ 4:45 PM						
Received By: [Signature]						
Date & Time:						

Clark Seif Clark

**Project Name: Winnetka Offices**  
**Project Location: 7111 Winnetka Avenue, Canoga Park CA**  
**CSC Project No.: 1031500**

**APPENDIX B**  
**XRF DATA SHEETS**



HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

CSC Project No. 1031500  
 Project Name: Magnolia Public Schools  
 Project Location: 7111 Winnetka Avenue, Canoga Park, CA  
 Client: Magnolia Public Schools

**XRF LEAD-BASED PAINT AND LEAD-CONTAINING MATERIALS INSPECTION REPORT**

Reading No	Site	Room	Side	Component	Substrate	Condition	Color	Results			
								Results	PbC	PbC Error	Units
1		SHUTTER CALIBRATION							4.03	0	cps
2		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.7	0.1	mg / cm ^2
3		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.8	0.1	mg / cm ^2
4		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.7	0.1	mg / cm ^2
5	7111 Winnetka	LOBBY	C	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
6	7111 Winnetka	LOBBY	C	FLOOR	CERAMIC	INTACT	BLACK	Negative	0	0.02	mg / cm ^2
7	7111 Winnetka	LOBBY	D	WALL	DRYWALL	INTACT	RED	Negative	0	0.02	mg / cm ^2
8	7111 Winnetka	BATHROOM	D	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
9	7111 Winnetka	BATHROOM	C	DOOR	WOOD	INTACT	BLUE	Negative	0	0.02	mg / cm ^2
10	7111 Winnetka	BATHROOM	C	DOOR	WOOD	INTACT	BLUE	Negative	0	0.02	mg / cm ^2
11	7111 Winnetka	BATHROOM	B	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
12	7111 Winnetka	RADIOLOGY	D	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
13	7111 Winnetka	RADIOLOGY	B	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
14	7111 Winnetka	SE BATHROOM		FLOOR	CERAMIC	INTACT	WHITE	Negative	0.01	0.02	mg / cm ^2
15	7111 Winnetka	SE BATHROOM		SINK	PORCELAIN	INTACT	WHITE	Negative	0	0.03	mg / cm ^2
16	7111 Winnetka	SE BATHROOM	A	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
17	7111 Winnetka	NE ENTRY		FLOOR	CERAMIC	INTACT	BEIGE	Negative	0.05	0.06	mg / cm ^2
18	7111 Winnetka	NE ENTRY	C	BASEBOARD	WOOD	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
19	7111 Winnetka	CENTER		FLOOR	CERAMIC	INTACT	BEIGE	Negative	0.02	0.02	mg / cm ^2
20	7111 Winnetka	N BATH		FLOOR	CERAMIC	INTACT	BEIGE	Negative	0	0.04	mg / cm ^2

Clark Seif Clark, INC.

PO Box 4299, Chatsworth, California 91313  
 Office 818 727-2553, Fax 818 727-2556, Web: csceng.com



HEALTH &amp; SAFETY • ENGINEERING • ENVIRONMENTAL

CSC Project No. 1031500  
 Project Name: Magnolia Public Schools  
 Project Location: 7111 Winnetka Avenue, Canoga Park, CA  
 Client: Magnolia Public Schools

## XRF LEAD-BASED PAINT AND LEAD-CONTAINING MATERIALS INSPECTION REPORT

Reading No	Site	Room	Side	Component	Substrate	Condition	Color	Results			
								Results	PbC	PbC Error	Units
21	7111 Winnetka	N BATH	A	WALL	DRYWALL	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
22	7111 Winnetka	STE 1 PVT	B	WALL	WOOD	INTACT	WHITE	Positive	42.9	25.1	mg / cm ^2
23	7111 Winnetka	STE 1 PVT	B	WALL	WOOD	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
24	7111 Winnetka	STE 1 PVT	B	COLUMN	METAL	INTACT	BROWN	Negative	0	0.04	mg / cm ^2
25	7111 Winnetka	STE 1 PVT	B	COLUMN	METAL	INTACT	BROWN	Negative	0.01	0.03	mg / cm ^2
26	7111 Winnetka	HALL	C	WINDOW	METAL	INTACT	BLUE	Negative	0	0.02	mg / cm ^2
27	7111 Winnetka	STE 20	D	WALL	DRYWALL	INTACT	BEIGE	Negative	0	0.02	mg / cm ^2
28	7111 Winnetka	STE 20	D	DOOR	WOOD	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
29	7111 Winnetka	STE 20	D	DOOR	WOOD	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
30	7111 Winnetka	STE 20	D	DOOR	WOOD	INTACT	BROWN	Negative	0	0.02	mg / cm ^2
31	7111 Winnetka	OUTSIDE	A	WALL	STUCCO	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
32	7111 Winnetka	OUTSIDE	A	COLUMN	CERAMIC	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
33	7111 Winnetka	OUTSIDE		FLOOR	CERAMIC	INTACT	BROWN	Negative	0	0.02	mg / cm ^2
34	7111 Winnetka	OUTSIDE	D	WALL	STUCCO	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
35	7111 Winnetka	OUTSIDE	D	WALL	CERAMIC	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
36	7111 Winnetka	OUTSIDE	D	WALL	CERAMIC	INTACT	WHITE	Negative	0.01	0.02	mg / cm ^2
37	7111 Winnetka	OUTSIDE	C	WALL	CMU	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
38	7111 Winnetka	OUTSIDE	C	BOLLARD	CONCRETE	INTACT	YELLOW	Negative	0	0.02	mg / cm ^2
39	7111 Winnetka	OUTSIDE	A	STRIPING	CONCRETE	INTACT	WHITE	Negative	0	0.02	mg / cm ^2
40	7111 Winnetka	OUTSIDE	A	STRIPING	CONCRETE	INTACT	BLUE	Negative	0	0.02	mg / cm ^2

Clark Seif Clark, INC.

PO Box 4299, Chatsworth, California 91313  
 Office 818 727-2553, Fax 818 727-2556, Web: csceng.com





HEALTH & SAFETY • ENGINEERING • ENVIRONMENTAL

CSC Project No. 1031500  
Project Name: Magnolia Public Schools  
Project Location: 7111 Winnetka Avenue, Canoga Park, CA  
Client: Magnolia Public Schools

**XRF LEAD-BASED PAINT AND LEAD-CONTAINING MATERIALS INSPECTION REPORT**

Reading No	Site	Room	Side	Component	Substrate	Condition	Color	Results			
								Results	PbC	PbC Error	Units
41		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.8	0.1	mg / cm ^2
42		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.7	0.1	mg / cm ^2
43		NITON CALIBRATION - SRM 2574					GOLD	Positive	0.8	0.1	mg / cm ^2

**Action Level is  $\geq 0.7$  mg/cm<sup>2</sup>**

**Inspection Comments:**

This XRF inspection was performed on October 25, 2021 with a Niton XLp300 series lead detector, serial no. 25374

Inspector signature

LRC-00006856

CDPH Certification

October 25, 2022

Date

**Project Name: Winnetka Offices**  
**Project Location: 7111 Winnetka Avenue, Canoga Park CA**  
**CSC Project No.: 1031500**

**APPENDIX C**  
**SITE PHOTOGRAPHS**



Photo 1: East elevation



Photo 2: North elevation



Photo 3: West elevation



Photo 4: Asphalt paving on the east parking lot

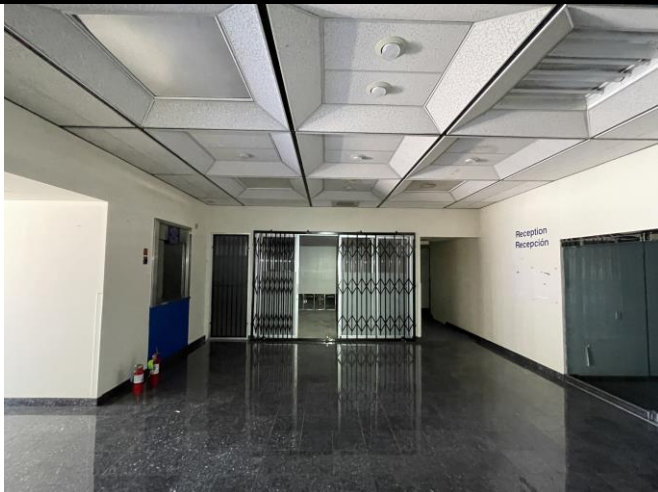


Photo 5: Main lobby at the east entrance



Photo 6: South entrance lobby





Photo 7: Typical interior corridor



Photo 8: Yellow carpet glur



Photo 9: Gray terrazzo print vinyl sheet flooring



Photo 10: Blue gray terrazzo print vinyl sheet flooring



Photo 11: ACM flooring under laminate



Photo 12: ACM flooring under sheet vinyl





Photo 13: ACM flooring

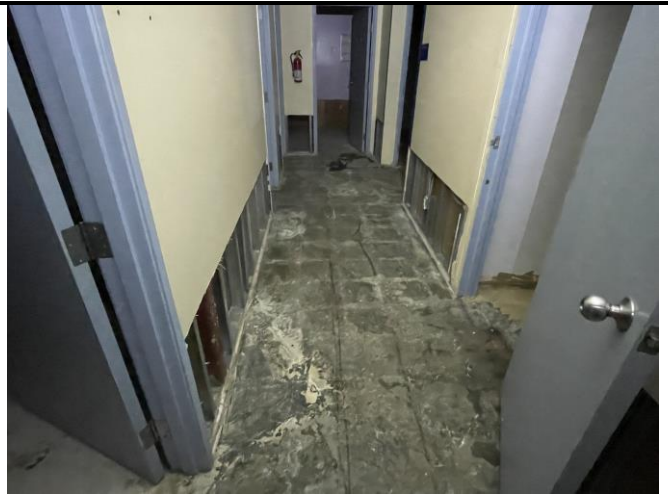


Photo 14: Suite 14 with flooring removed, ACM mastic on slab



Photo 15: Non-ACM fireproofing on I-Beams above drop ceiling



Photo 16: Non-ACM pipe insulation above drop ceiling



Photo 17: Roof field



Photo 18: ACM roof mastic at the penetrations and flashings

**Project Name: Winnetka Offices**  
**Project Location: 7111 Winnetka Avenue, Canoga Park CA**  
**CSC Project No.: 1031500**

**APPENDIX D**  
**SITE SKETCH**



**APPENDIX E**

**ACCREDITATIONS AND CERTIFICATIONS**



State of California  
Division of Occupational Safety and Health  
**Certified Asbestos Consultant**

**Christian Goerrissen**

Name



Certification No. **00-2840**

Expires on **01/05/23**

This certification was issued by the Division of Occupational Safety and Health as authorized by Sections 7180 et seq. of the Business and Professions Code.



STATE OF CALIFORNIA  
DEPARTMENT OF PUBLIC HEALTH



## LEAD-RELATED CONSTRUCTION CERTIFICATE

INDIVIDUAL:



Christian Goerrissen

CERTIFICATE TYPE:

Lead Inspector/Assessor

Lead Project Monitor

NUMBER:

LRC-00000162

LRC-00000161

EXPIRATION DATE:

5/14/2023

5/14/2023

Disclaimer: This document alone should not be relied upon to confirm certification status. Compare the individual's photo and name to another valid form of government issued photo identification. Verify the individual's certification status by searching for Lead-Related Construction Professionals at [www.cdph.ca.gov/programs/clppb](http://www.cdph.ca.gov/programs/clppb) or calling (800) 597-LEAD

State of California  
Division of Occupational Safety and Health  
**Certified Asbestos Consultant**

**Devon H Charnley**

Name

Certification No. **11-6982**

Expires on **01/21/23**

This certification was issued by the Division of Occupational Safety and Health as authorized by Sections 7180 et seq. of the Business and Professions Code.





STATE OF CALIFORNIA  
DEPARTMENT OF PUBLIC HEALTH



# LEAD-RELATED CONSTRUCTION CERTIFICATE

INDIVIDUAL:



**Devon Charnley**

CERTIFICATE TYPE:

Lead Sampling Technician

Lead Project Monitor

NUMBER:

LRC-00006856

LRC-00010248

EXPIRATION DATE:

8/13/2023

7/19/2023

Disclaimer: This document alone should not be relied upon to confirm certification status. Compare the individual's photo and name to another valid form of government issued photo identification. Verify the individual's certification status by searching for Lead-Related Construction Professionals at [www.cdph.ca.gov/programs/clpph](http://www.cdph.ca.gov/programs/clpph) or calling (800) 597-LEAD



## *EXHIBIT B*

### *Interior Demolition RFP Response*



*Corporate Office  
2621 Honolulu Avenue  
Montrose, CA 91020  
www.interiordemolition.net*

## **REVISED PROPOSAL**

March 13, 2023

Between the Owner: **Magnolia Public Schools  
250 east 1st Street  
Los Angeles, California 90012**

And the Contractor: **Interior Demolition, Inc.  
23508 Pine St.  
Newhall, California 91321  
United States  
CSLB# 603409  
818.249.4932  
Estimator: Marco Molina  
Cell 818.262.1611  
DIR# 1000004790  
DBE, MBE, SBE CERTIFIED**

For the Project: **Abatement & Building and Site Demolition at 7111  
Winnetka Ave. Winnetka, CA 91306**

### **Scope of work:**

The general scope of work is (1) the abatement of the asbestos and lead based paint and (2) the demolition of the existing one story structure and site asphalt on the site as indicated on the attached Alta survey and detailed within the scope of work. The site address is 7111 Winnetka Ave, Winnetka CA 91306. The successful respondent(s) shall be responsible for the following:

- Obtain all permits as required by State, County and Local Authorities.
- All soil erosion and sedimentation control measures as required including maintenance of such.
- All utility shutdowns and disconnections, including scheduling and coordination with utility companies, including demolition and capping of utilities at right of way for future use. This includes but is not restricted to electric, natural gas, water, storm, sanitary, phone, cable and fiber optic. All utility company fees for disconnections will be paid by the Owner.
- Lead and Asbestos Abatement per the LBP & ABM report.
- All Investigations and Assessments needed to develop a suitable abatement and demolition plan.
- Complete demolition of the structure on the property, including but not restricted to all below grade footings, foundations, slabs, piping, wiring and ductwork.
- Backfill of all excavated and/or demolished areas with compacted fill material.

- Coordination with all Owner's Consultants and Contractors.
- The selected firm shall provide temporary facilities, services, barriers, pollution controls, prevention of wind-blown debris leaving the site, enclosures, and removal and legal disposal of all demolition and construction debris as required by local, state, and federal codes. This includes securing the site during demolition, and until construction activity begins, with a temporary fence around the demolition areas.
- All demolition work must adhere to all municipal demolition regulations. It is the responsibility of the demolition contractor to verify these regulations and to adhere to them at all times.
- The existing one-story wood frame building is approximately 21,000 square feet and was constructed in 1979.
- The demolition plan will need to be submitted and approved by the City of Los Angeles Department of Building and Safety. Securing a demolition permit, and all other necessary municipal approvals, will be the responsibility of the selected firm.

**WORK TO BE DONE:** GENERAL PREVAILING WAGE DETERMINATION MADE BY THE DIRECTOR OF INDUSTRIAL RELATIONS PURSUANT TO CALIFORNIA LABOR CODE PART 7, CHAPTER 1, ARTICLE 2, SECTIONS 1770, 1773 AND 1773.1 FOR COMMERCIAL BUILDINGS, HIGHWAY, HEAVY CONSTRUCTION AND DREDGING PROJECTS

**Exclusions:**

The following are Excluded Unless specifically noted in the scope of work section above. If required they must be provided by others. Any delays due to necessary excluded items completed will result in extra charges.

Bonds, Deposits, Traffic control, Sanitation Facilities Water meter, Construction water, franchised Disposal or Mandated Recycling, Construction fencing, SWPPP, Canopies, Barricades, Protection, Shoring, Bracing, Lagging, Underpinning, Scaffolding, Site security, Engineering, staking, Earthwork, Grading, Backfill & Compaction, Dewatering, Tree root chasing, Filling of Cesspools, well capping, Testing, Salvage for others, Preparation, Petro-Mat, Pilings, Grade Beams, Aggregate base, Soil, Sand, Unforeseen conditions, off-site work, Temporary services. No new construction.

**TOTAL BASE PRICE: \$309,424.52**

**PAYMENT TERMS:**

Payment terms as follows: Payment shall be completed 30 to 45 days after the completion of work at each individual property.

**Project Totals:**

Name	Total Cost
<b>Demolition</b>	
Demolition	
Building	<b>\$150,718.02</b>

Concrete	\$63,901.50
Wall	\$5,410.00
Trees	\$1,400.00
Planter	\$2,525.00
Erosion Control	\$3,000.00
Permits	\$3,000.00
Demolition Subtotal:	\$229,954.52

<b>Abatement</b>	
Abatement	
Asbestos Abatement	\$79,470.00
Abatement Subtotal:	\$79,470.00
Grand Total	\$309,424.52

#### TERMS AND CONDITIONS:

In the event of litigation between the parties arising out of this Agreement, the prevailing party shall be entitled to recover its reasonable attorney's fees and litigation expenses incurred in addition to whatever relief to which it may be entitled. Attorney's fees and litigation expenses shall include without limitation, costs of preparation and discovery and retaining expert witnesses, and such fees and expenses shall be payable whether or not the litigation proceeds to final judgment. This proposal /agreement is valid for 90 days. \*\*Price subject to change upon increasing prices of materials and/or expenses required to complete the job.

### Acceptance of Agreement

\_\_\_\_\_  
Contractor Signature

\_\_\_\_\_  
Owner Signature

\_\_\_\_\_  
Name and Title

\_\_\_\_\_  
Name and Title